

✓ APPLICATION No.: 16542

LOCATION: 210 Whitman St

TAP CLEARED

OWNER: _____

31-313

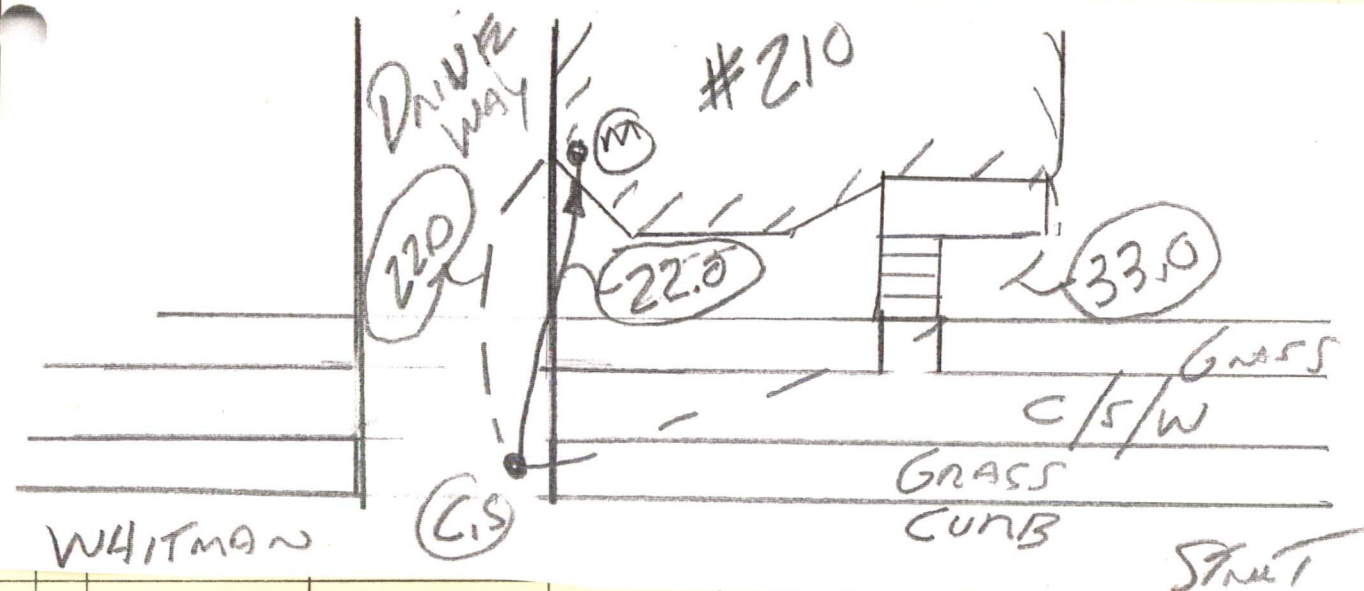
MEASURES: 1" Copper Service 4/18/2018
Lead Service Line Replacement Program
Phase 1, Contractor P Gioioso & Son
Type CU, Diameter 1in, Water pressure 59
Distance from main to curb stop (ft) N/A
Distance curb stop to meter (ft) 23
Distance from curb face to curb stop (ft) 2.3
Depth of service (ft) 3.8
Total length of new pipe installed (ft) 26
Curb stop repalced: NO
Corporation replaced: No
Ball valve replaced: Yes size 1"
Remarks: whip 3 ft

DATE

BEF.

AFT.

REMARKS

[illegible]

210
LOCATION: 212 Whitman S.S.E. of Bowditch

APPLICATION No.: 16542

TAP CLEARED 8320-1025

OWNER: Wm R. Wullipsetal

MEASURES: 5/8"

E from Bowditch 145.5 ft.
N from S Whitman 8.6 ft.
E from E house 0.3 ft.

MAY 19 1983 -- Renewed 6" outside curbstop to 4.6 ft. inside stop. 4.6 ft. - 5.0ft. 3/4" copper; 3/4" curb stop; stop box; 5/8" x 3/4" lead-cop. adapt. XXS; 5/8" x 3/4" lead-cop. adapt. XS;

- - - -

Dec 5, 1996: REnewed from main to curb stop 6" outside stop

Stock: 10 ft 3/4" copper tubing 1-3/4x3/4 cop-cop cplg.comp
1- 3/4x5/8 Fig 413
=====

821-461

DATE

BEF.

AFT.

REMARKS

12/5/96: tap reamed

964904202

[illegible]

This image shows a blank, aged, cream-colored page, likely an endpaper or flyleaf of a book. The paper has a slightly textured appearance with some faint horizontal lines and small dark spots, possibly due to age or handling. The page is set against a dark background.