

APPLICATION No.: 16867 5/8"

TAP CLEARED ✓

LOCATION: 157 Clifford St.

OWNER: Fidele Daigle

MEASURES: 5/8"

W from	Arlington	209.0 ft.
S from N line	Clifford	9.6 ft.
W from E line	House	6.0 ft.

Oct. 21, 1977: Renewed 1/2 ft. Outside curbstop to 1 ft. inside curbstop. 1 1/2 ft. - 3/4" copper; 2-5/8" x 3/4" lead to cop. adapt.XS; 3/4" curb stop; Caldwell stop box;

4/27/2011 - City crew renewed from main to meter stock: 40 ft - 3/4" copper tubing; 1 - 3/4" curb stop; 1 caldwell stop box; 1 - 5/8"x3/4" fig 413; tap cleaned; 2 - 3/4" meter couplings
foreman: Bill Days

1" Copper Service

09/12/2022 2022 Water main improvement program

Contractor: C. Naughton Corp.

Type CU Diameter 1"

Distance from main to curb 23.5'

Distance from curb stop to meter N/A

Distance curb face to curb stop 2'

Depth of Service 4'

Total length of new pipe installed 29.5'

Curb Stop replaced yes size 1"

Corporation replaced yes 1"


Ball Valve replaced yes N/A

Remarks: Type B- Connect to 3/4" Copper @ PL.

METER HISTORY

CHARGE OUTS

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS
4/9/62		5/8	Calmet	1764678					

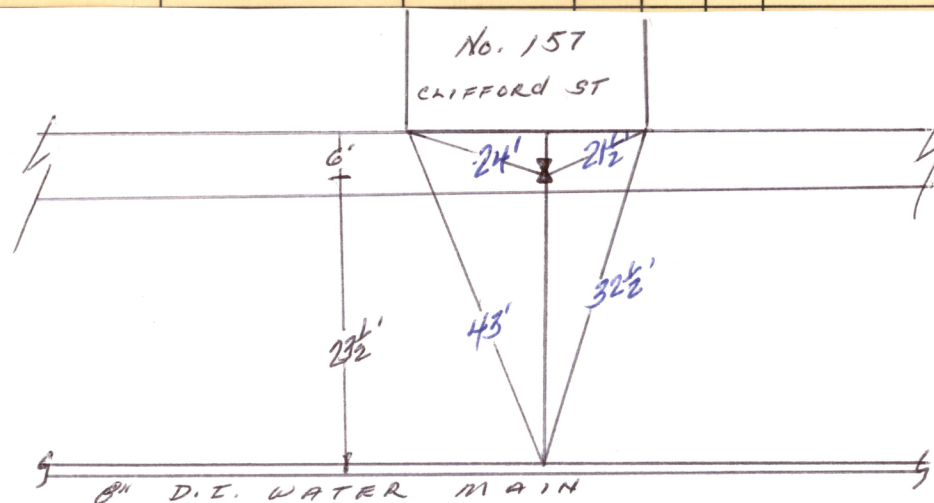

C L I F F O R D S T.