

APPLICATION No.: 17318

LOCATION: 96-98 CLIFFORD ST.

OWNER: Manuel Viveiros

31-313

Measures: 5/8"

W from Concord 216.8'

N from S line Clifford 8'

W from E line House 6.7'

1" Copper Service

09/13/2022 2022 Water main improvement program

Contractor: C. Naughton Corp.

Type CU Diameter 1"

Distance from main to curb 10.5'

Distance from curb stop to meter 15.5'

Distance curb face to curb stop 1.5'

Depth of Service 4'

Total length of new pipe installed 26'

Curb Stop replaced yes size 1"

Corporation replaced yes 1"

Ball Valve replaced yes N/A

Remarks: Type C - 1" Copper to meter 8' Lead pipe removed

TAP CLEARED

DATE _____

BEF.


AFT.

REMARKS

METER HISTORY

CHARGE OUTS

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

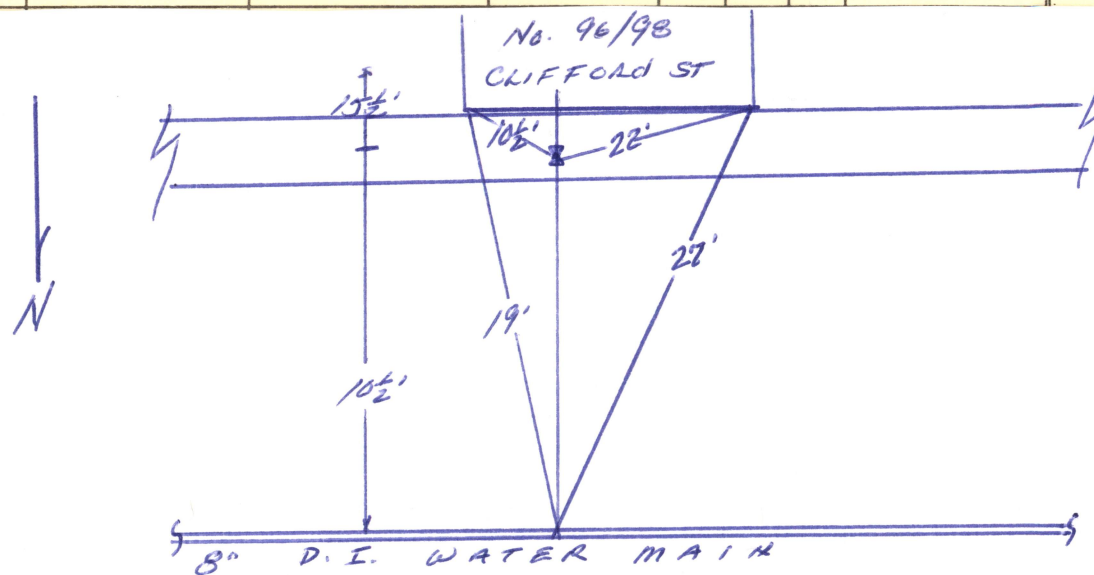

C L I F F O R D S T.