

APPLICATION No.: 17376

TAP CLEARED

LOCATION: 44 - 46 Fair St

DATE _____

BEF.

AFT.

REMARKS

OWNER:

31-313

MEASURES: 1" Copper Service

10/11/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & SOn

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) 23

Distance from curb stop to meter (ft) 0

Distance from curb face to curb stop (ft) 3

Depth of service (ft) 5

Total length of new pipe installed (ft) 23

Curb stop replaced: Yes, size 1"


Corporation replaced: Yes, size 1"

Ball valve furnished: no

METER HISTORY

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

CHARGE OUTS

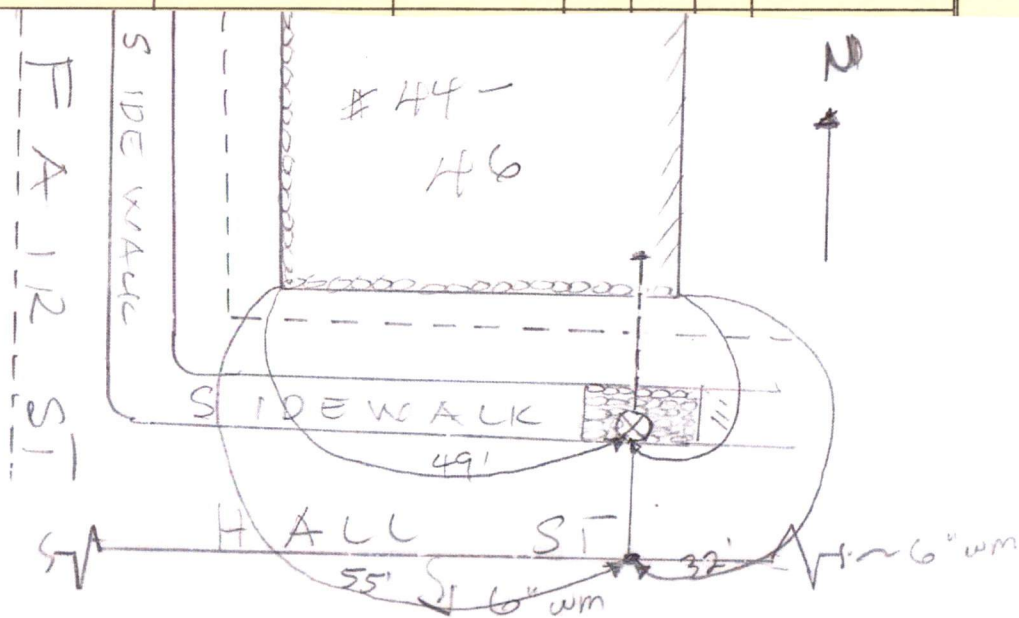

APPLICATION No.: 17376

TAP CLEARED

LOCATION: 44-6 Fair St.

OWNER: Charles Monteiro

MEASURES: 5/8" H lead July 28, 1919

S from Fair St. 59.0 ft.

W from E line Hall St. 7.3 ft.

N from S line house 4.0 ft.

August 3, 1976 Renewed from 6" outside curb stop to inside cellar.

3/4" Curb Stop Caldwell Stop Box

14 ft. - 3/4" Copper tubing (6' inside)

5/8" x 3/4" lead to copper adaptor XS

2/11/94: Renewed from main to a point 1.0ft Stock: 1.0ft 3/4" copper tubing 1-3/4x5/8 lead-cop adapt.xxs 1-3/4x5/8 Fig 413

=====

DATE

BEF.

AFT.

REMARKS

1-13-94

9402-01837

2-11-94

Clear Elev.

940602213

2/11/94: tap reamed

[illegible]

CHARGE OUTS

[illegible]