

APPLICATION No.: 17435

## TAP CLEARED

LOCATION: 371 Earle St

OWNER:

31-313

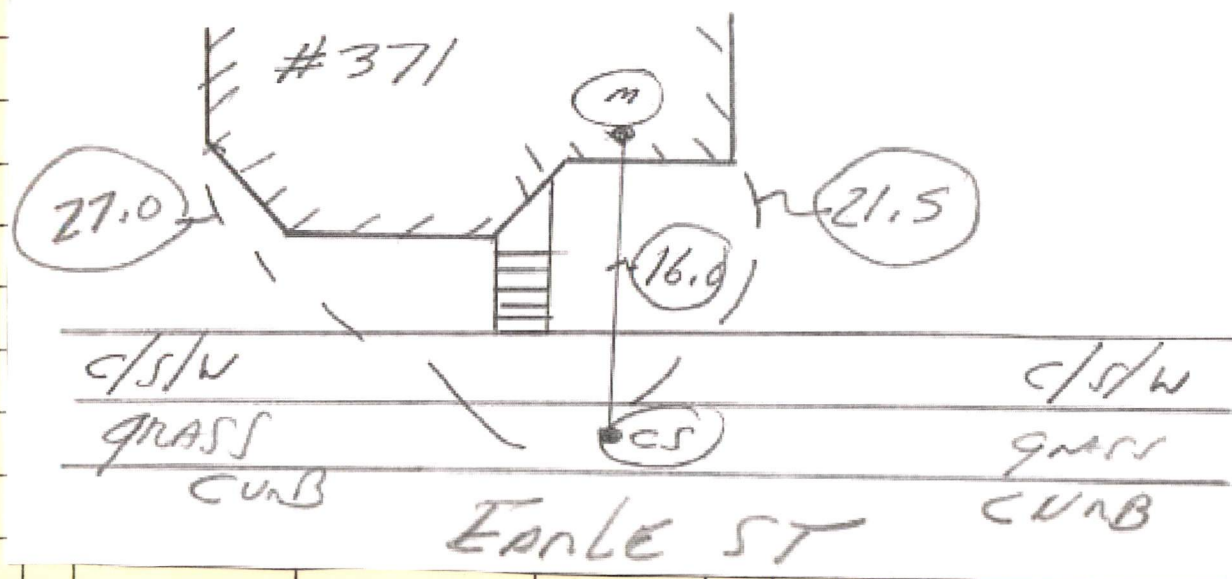
MEASURES: 06/18/2018 - Lead Service Line Replacement  
Program, Phase 1, Contractor P. Gioioso & Son  
Type CU, Diameter 1in, Water pressure 70  
Distance from main to curb stop (ft) N/A  
Distance from curb stop to meter (ft) 17.0  
16 ft to house + 1 ft to wall  
Distance from curb face to curb stop (ft) 2.0  
Depth of service (ft) 3.4  
Total length of new pipe installed (ft) 20.0  
17 ft + 3 ft whip  
Curb stop replaced: no  
Corporation replaced: no  
Ball Valve Furnished: yes, size 1"

DATE

BEF.

AFT.

REMARKS

[illegible]

TAP CLEARED #319-1265 ✓

DATE	BEF.	AFT.	REMARKS
------	------	------	---------

10/13/04	Tap	Reamed
----------	-----	--------

10/13/04 Also repaired 3 ft. section of 6" sewer. Stock: 3 ft. 6" PVC; 2 - 6" clay-plastic cplgs.

[illegible]

## CHARGE OUTS\*

[illegible]