

APPLICATION No.: 17436

LOCATION: 377 Earle St

## TAP CLEARED

OWNER: \_\_\_\_\_

31-313

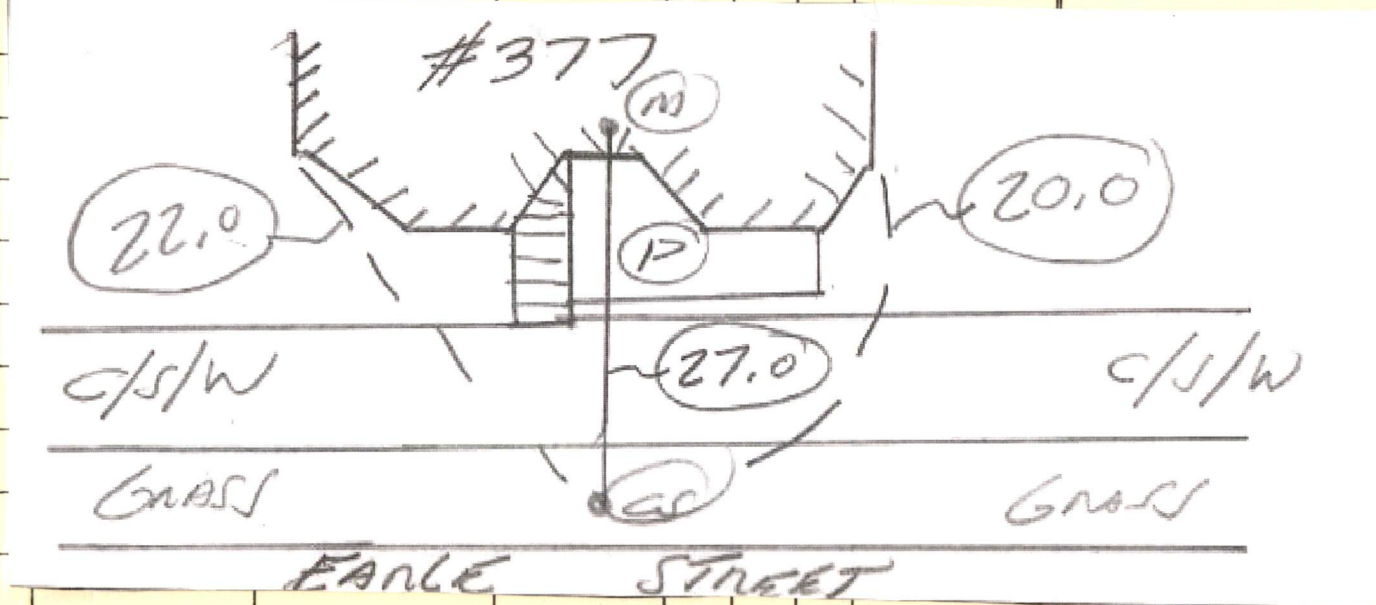
MEASURES: 06/19/2018 - Lead Service Line Replacement  
Program, Phase 1, Contractor P Gioioso & Son  
Type CU, Diameter 1in, Water Pressure 70  
Distance from main to curb stop (ft) N/A  
Distance from curb stop to meter (ft) 28.0  
27 ft to house + 1 ft to wall  
Distance from curb face to curb stop (ft) 1.5  
Depth of service (ft) 3.5  
Total length of new pipe installed (ft) 31.0  
28 ft + 3 ft whip  
Curb stop replaced: no  
Corporation replaced: no  
Ball Valve Furnished: yes, size 1"

DATE

BEF.

AFT.

REMARKS

[illegible]



17436

L 2543 ✓

377 Ealre N.E.COR.Church

William F. Duffy

 $5/8''$ 

Church

21.4

Earel-

9.3

House

10.7

Dec. 17, 1980: Renewed from 6" outside curbstop to the line.  
8.5 ft.-3/4" copper

8.5 ft. -  $3/4$ " copper

1-3/4" curb stop      1-Stop box

2-5/8" x 3/4" lead-cop. adapt. XS

10/14/04 Renewed from main to property line. Stock: 30 ft. 3/4" copper tubing; 3/4" curb stop; Caldwell stop box; 5/8" x 3/4" lead-cop adapt. XS; 5/8" x 3/4" Fig. 413 Tap reamed

copper tubing; 3/4" curb stop; Caldwell stop box; 5/8" x 3/4"

lead-cop adapt. XS; 5/8" x 3/4" Fig. 413 Tap reamed

## METER HISTORY

[illegible]

## CHARGE OUTS