

APPLICATION No.: 18105

TAP CLEARED

LOCATION: 4060 Acushnet Ave

DATE

BEF.

AFT.

REMARKS

OWNER:

31-313

MEASURES:

August 10, 1912

N from Braley Rd 326.3'

W from E line Acushnet Ave 6.8'

S from N line House 2.5'

1" COPPER

12-14-17: Lead service line replacement program
phase 1, TYPE CU, Diameter 1, Water Pressure Not recorded

Contractor: P. Gioioso

Distance from main to curb stop N/A

Distance curb stop to meter 40.0'

Distance from curb face to curb stop 4.9'

Depth of service 5.0'

Total length of new pipe installed 40.0'

Curb stop replaced: NO Size N/A

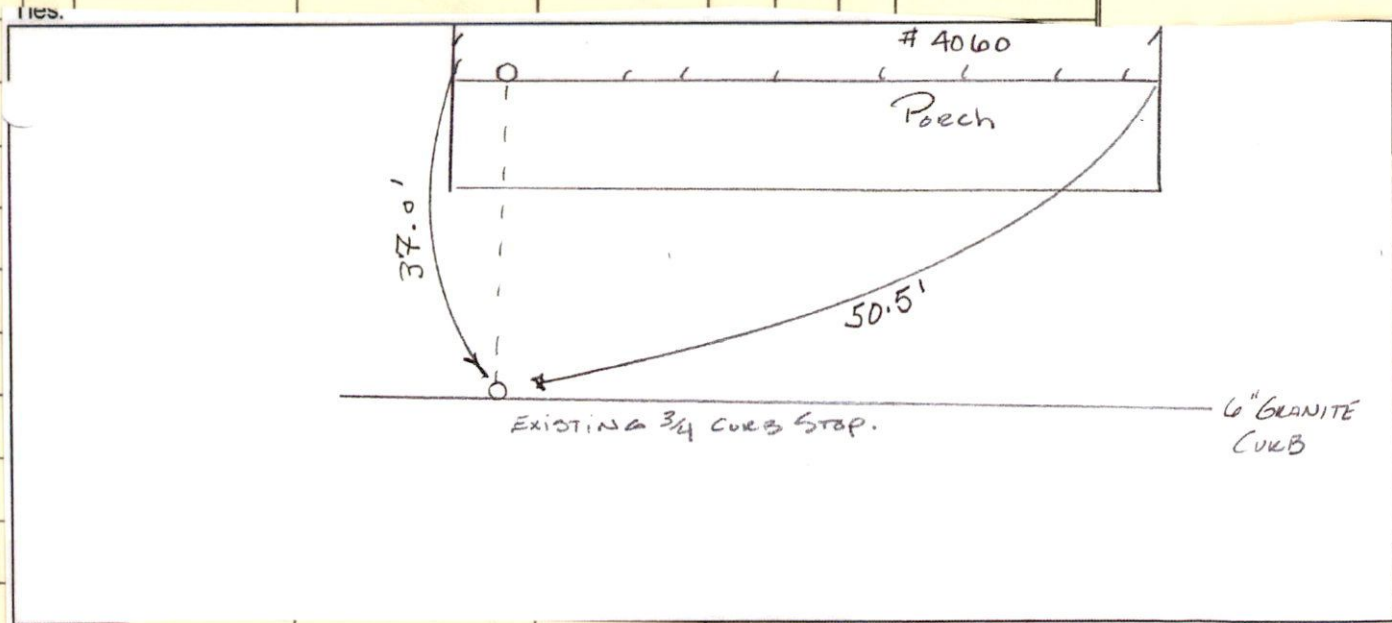
Corporation replaced: YES Size 1"

Ball valve furnished: YES Size 1"

3-27-08

[illegible]

CHARGE OUTS

[illegible]