

APPLICATION No.:

169 CLIFFORD ST.

Victor Chausse

31-313

Measures:	5/8"	L Lead	05.13.1922
	E from	Ashley Blvd	110.7'
	S from N line	Clifford	9'
	E from W line	House	11.5'

1" Copper Service

09/14/2022 2022 Water main improvement program

Contractor: C. Naughton Corp.

Type CU Diameter 1"

Distance from main to curb 22.50'

Distance from curb stop to meter 20'

Distance curb face to curb stop 1.50

Depth of Service 4.50'

Total length of new pipe installed 43.50'

Curb Stop replaced yes size 1"

Corporation replaced yes 1"

Ball Valve replaced yes N/A

Remarks: Type C- 1" Copper to meter

TAP CLEARED

DATE _____

BEF.


AFT.

REMARKS

METER HISTORY

CHARGE OUTS

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

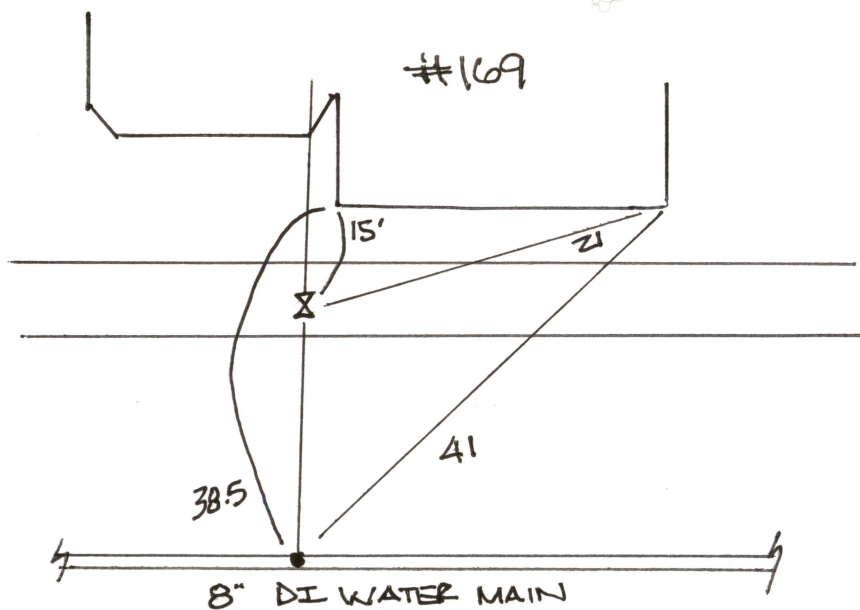

CLIFFORD ST.