

APPLICATION No.:

18693

LOCATION:

OWNER:

31-313

Measures:	3/4"	L Lead	06.06.1922
	W from	Acushnet Ave	212.8'
	N from S line	Clifford	8.6'
	W from E line	House	5.2'

1" Copper Service

08/25/2022 2022 Water main improvement program

Contractor: C. Naughton Corp.

Type CU Diameter 1"

Distance from main to curb 10'

Distance from curb stop to meter 40'

Distance curb face to curb stop 1.50'

Depth of Service 4.50'

Total length of new pipe installed 50'

Curb Stop replaced yes size 1"

Corporation replaced yes 1"

Ball Valve replaced yes NA

Remarks: Type C 1" Copper to meter

TAP CLEARED

DATE _____

BEF.


AFT.

REMARKS

METER HISTORY

CHARGE OUTS

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

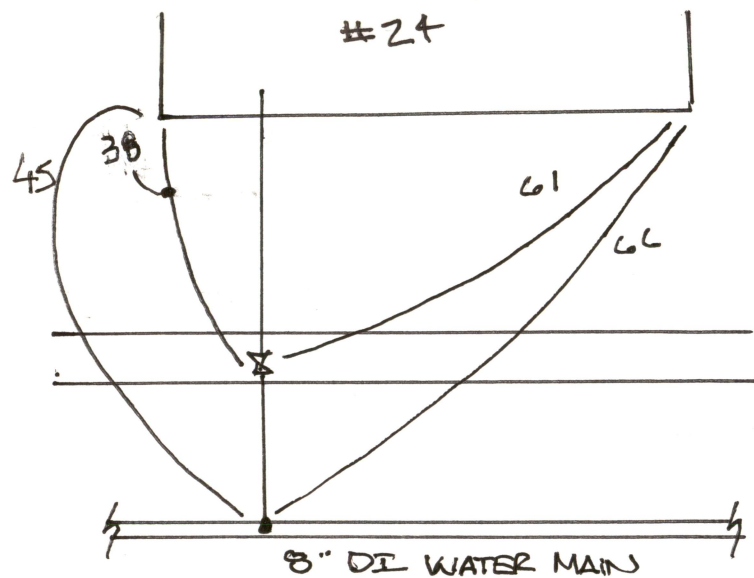

CLIFFORD ST.