

APPLICATION No.: 18828 5/8" L lead

TAP CLEARED

LOCATION: 106-108 Clifford St. S.S. E. of Arlington St.

OWNER: George Pappas

MEASURES:	5/8"	L lead	Aug. 3, 1922
	E from	Arlington	220.9 ft.
	N from Sline	Clifford	8.0 ft.
	E from Wline	House	14.8 ft.

12/27/78: Renewed 6" outside curbstop to prop. line;
7½ ft.-3/4" copper; 2-5/8" x 3/4" lead-cop. adapt.XS;
3/4" curb stop; Caldwell stop box;

1" Copper Service

09/07/2022 2022 Water main improvement program

Contractor: C. Naughton Corp.

Type CU Diameter 1"

Distance from main to curb 10'5'

Distance from curb stop to meter N/A

Distance curb face to curb stop 2'

Depth of Service 4'

Total length of new pipe installed 16.5'

Curb Stop replaced yes size 1"

Corporation replaced yes 1"

Ball Valve replaced yes N/A

Remarks: Type B - Connect to ¾" Copper @ PL.

DATE

BEF.

AFT.


REMARKS



METER HISTORY

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS
10/19/67		5/8	Hersey F	1549586					

CHARGE OUTS

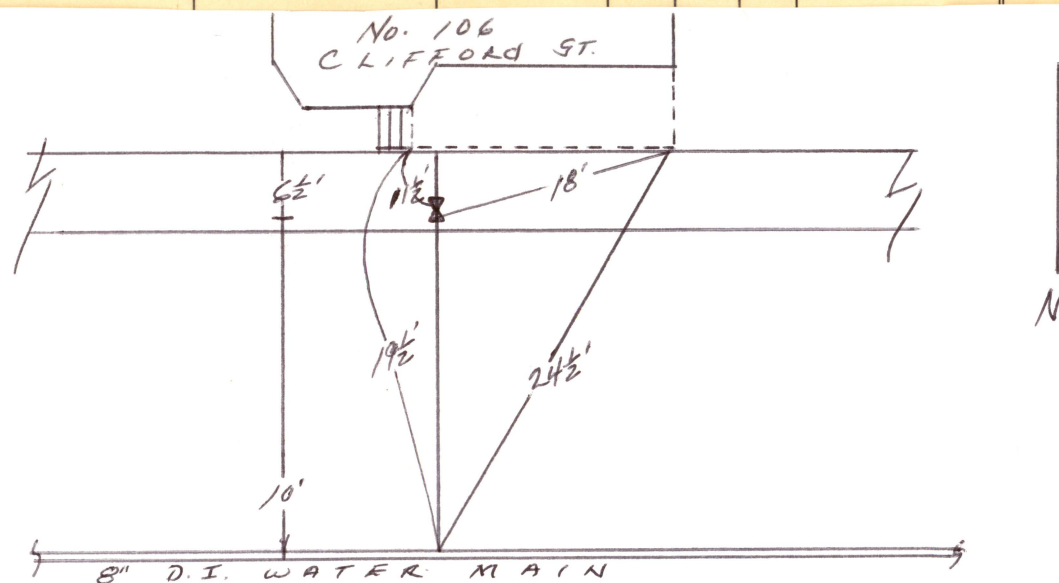

C L I F F O R D S T.