

APPLICATION No.: 19357

## TAP CLEARED

LOCATION: 4 Rockland St

OWNER:

31-313

MEASURES: April 26, 1923

W X Acushnet Ave 87.8 ft

N X S Line Rockland 7.6 ft

E X W Line House 3.7 ft

1" Copper Service

11/27/2018 Lead service replacement program

Phase 1, Contractor P Gioioso &amp; Son

Type CU, Diameter 1in, Water pressure 90

Distance main to curb stop (ft) 87.5

Distance curb stop to meter (ft) 14.7

Distance from curb face to curb stop (ft) 0.8

Depth of service (ft) 3.5

Total length of new pipe installed (ft) 4

Curb stop replaced: Yes size 1"

Corporation replaced: Yes size 1"

Ball valve replaced: Yes size 1"

Remarks: water service connected to hydrant  
service line at 8-in water main stub at  
Acushnet Ave/ Rockland intersection

DATE

BEF.


AFT.

REMARKS

# METER HISTORY

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

# CHARGE OUTS

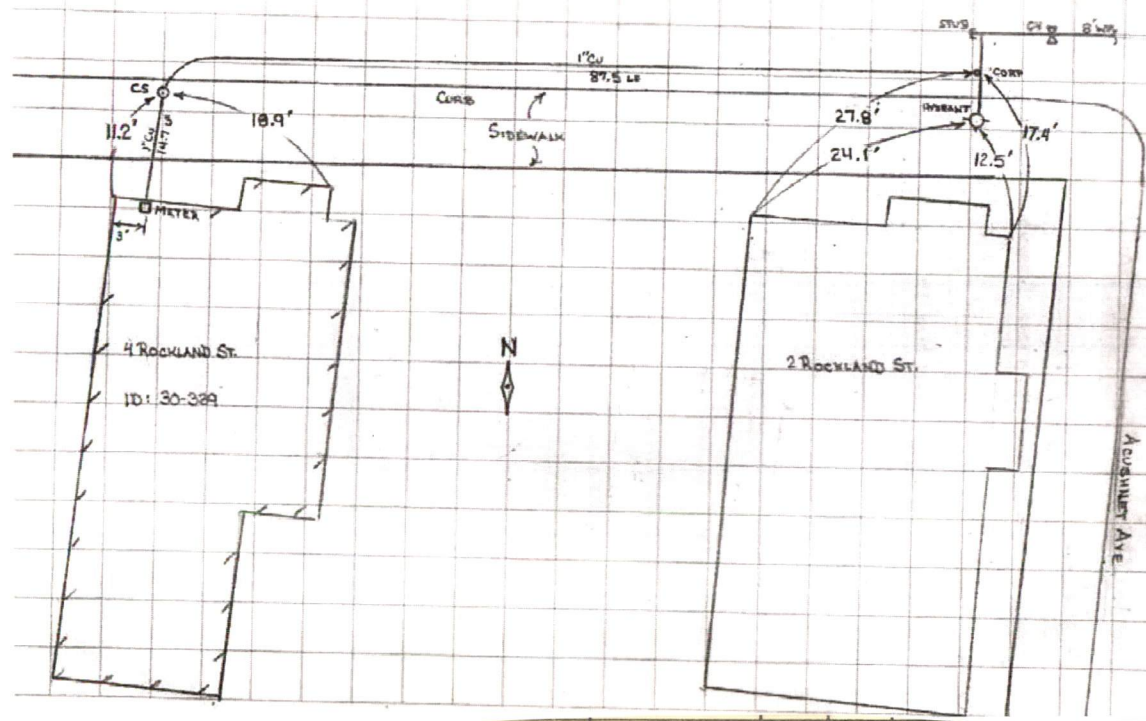

APPLICATION No.: 9837

LOCATION: 4 Rockland

OWNER:

MEASURES:  $\frac{1}{100}$

Conn of 1143 made by owner.

## TAP CLEARED

[illegible]



[illegible]

## CHARGE OUTS

[illegible]