

APPLICATION No.: ~~5695~~ 19477

## TAP CLEARED

LOCATION: 2 Jennings Court

DATE

BEF.

AFT.

REMARKS

OWNER:

31-313

9/15/99 Ream

MEASURES:

1" Copper Service

05/10/2019 Lead Service Line Replacement Program

Phase 1 Contractor P GiOioso &amp; Son

Type CU, Diameter 1in, Water pressure 100

Distance from curb stom to main (ft) N/A

Distance from curb stop to meter (ft) 50

Distance from curb face to curb stop (ft) 2.5

Depth of service (ft) 4.5

Total length of new pipe installed (ft) 50


Curb stop replaced: no size 3/4"

Corporation replaced: no size 3/4"

Ball valve furnished: yes size 1"

[illegible]

---

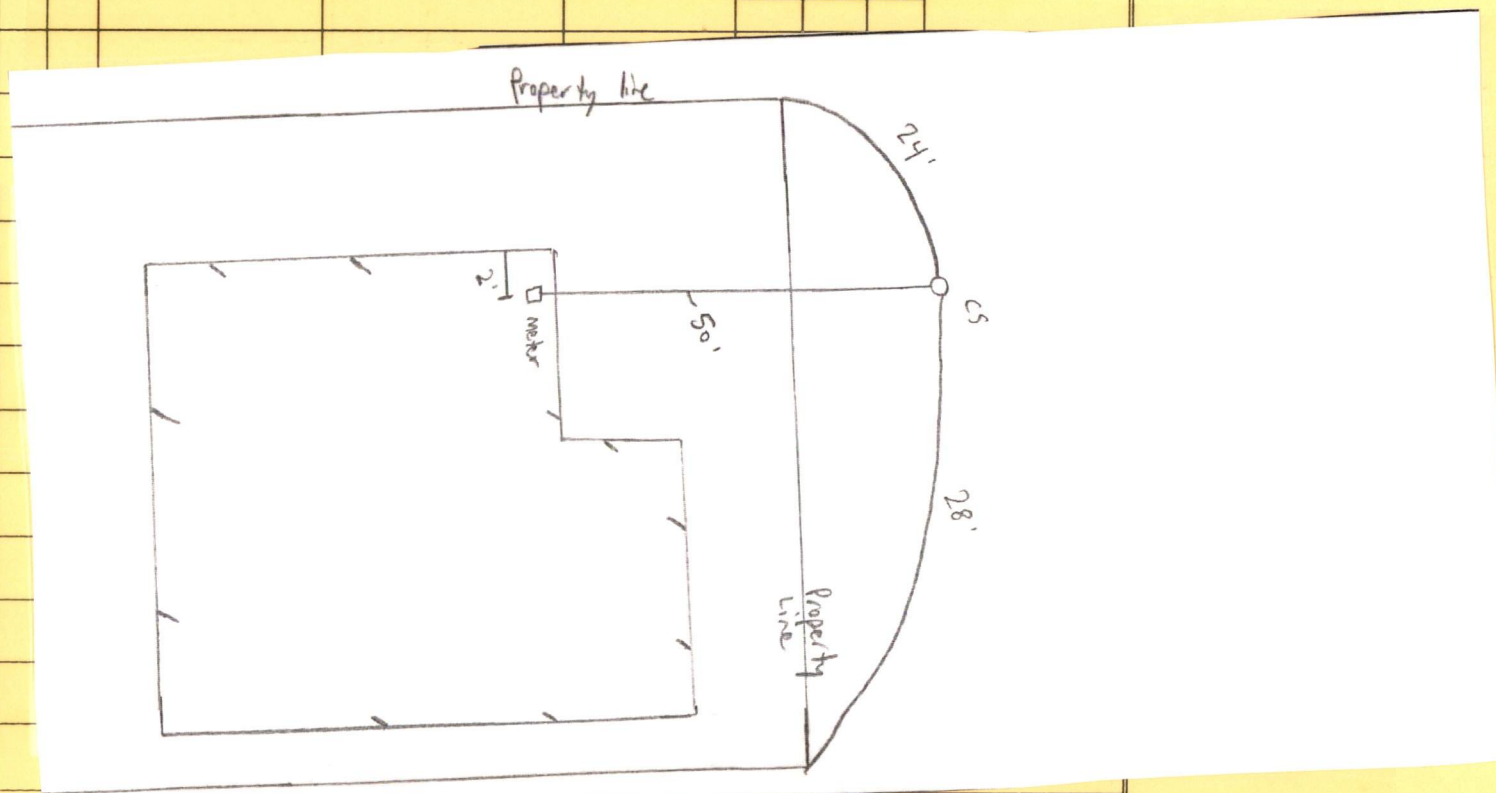

APPLICATION No.: 5695

## TAP CLEARED

LOCATION: 2 Jennings Court

C 19477

DATE

BEF.

AFT.

REMARKS

OWNER: Anthony Mikus

9-15-99 Tap reamed

MEASURES: 1/2"

H lead

Nov. 8, 1887

S from

Division St. 151.5 ft.

E from W line

First St.

6.9 ft.

S from N line

house

0.5 ft.

April 15, 1968 Renewed from 3 ft. outside curb stop  
to 1 ft. inside curb stop.

4 ft. - 3/4" Copper tubing 1 wipe joint

3/4" Curb stop 3/4" cop to cop cplg.

NOTE: 3/4" cop. cplg. is 1 ft. inside curb stop

- - -

9-15-99 DW White renewed from main to property line.

Stock: 15 ft. - 3/4" Copper tubing, 1 - 3/4" Curb Stop

1 - Caldwell Stop Box, 1 - 5/8"x3/4" lead to cop.

adapt.XS, 1- 5/8"x3/4" Fig. 413. DW White to  
maintain cut.



[illegible]

CHARGE OUTS