

APPLICATION No.: 2111

## TAP CLEARED

LOCATION: 95 Madison St

OWNER:

31-313

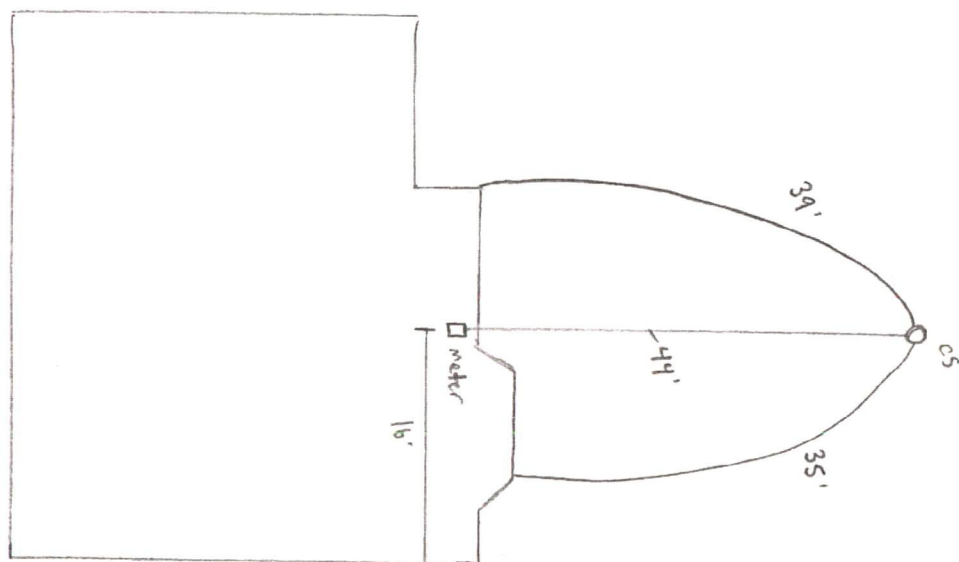
MEASURES: 1" Copper Service  
06/10/2019 Lead Service Replacement Program  
Phase 1, Contractor P Gioioso & Son  
Type CU, Diameter 1in, Water pressure 100  
Distance from curb sop to main (ft) N/A  
Distance from curb stop to meter (ft) 44  
Distance from curb face to curb stop (ft) 2.8  
Depth of service 3.5  
Total length of new pipe installed (ft) 44  
Curb stop replaced: yes size 1"  
Corporation replaced: no  
Ball valve replaced: yes size 1"

DATE

BEF.

AFT.

REMARKS

[illegible]

APPLICATION No.: 2111TAP CLEARED 8507-0001LOCATION: 95 MadisonOWNER: W. Kempton ReadMEASURES: 1"

E from

Orchard

240.7 ft.

S from N line

Madison

6.3 ft.

E from W line

House

19.6 ft.

2/11/85: Renewed from 1/2' outside curb stop to a point

4.0 ft. Stock: 4.5 ft. 1" copper tubing 1 1" curb stop

1 #1 Caldwell stop box 2 1" lead to cop adapt. comp xxs

=====

9/5/18 Riley Bros pulled service

9/7/18 we renewed main to prop line

27 ft 1" copper tubing

~~1 ft copper tubing~~

1 ft 1" copper curb stop valve

1 ft 1 1/2" corp adapter

1 ft cast iron curb stop boxes

1 ft 1" to 1" lead to copper

worker: Ronald Aguiar - dpi



[illegible]

## CHARGE OUTS

[illegible]