

APPLICATION No.: 21773

TAP CLEARED

LOCATION: 1495 Morton Ave

OWNER:

31-313

MEASURES: 05/29/39

S X T Pole 18.0 ft

S X Meadow St 6.3 ft

E X W Line Morton Ave 8.5 ft

S X S Line House 8.0 ft

1" Copper Service

04/19/2018 Lead Service Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 82

Distance from main to curb stop (ft) 7.9

Distance curb stop to meter (ft) 14.5

Distance from curb face to curb stop (ft) 4.0

Depth of service (ft) 4.5

Total length of new pipe installed (ft) 24.5

Curb stop replaced: yes size 1"

Corporation replaced: yes size 1"

Ball valve replaced: yes size 1"

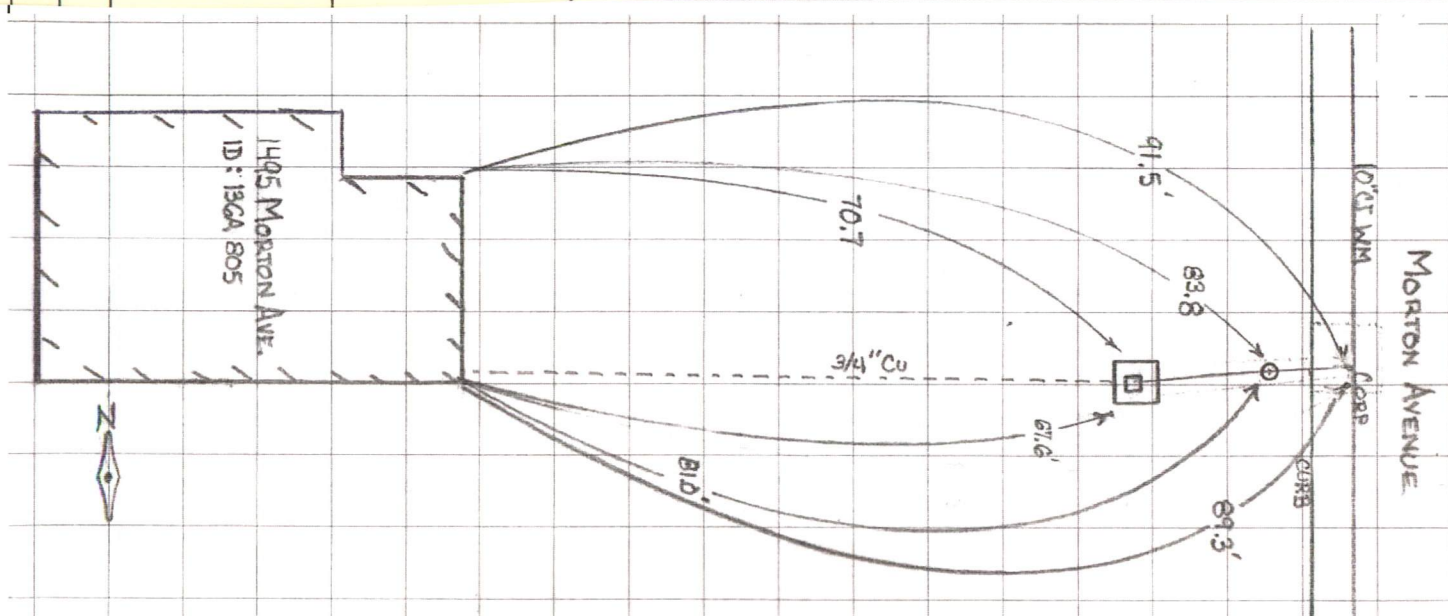
REmarks: meter pit service

DATE

BEF.

AFT.

REMARKS

[illegible][illegible]