

APPLICATION No.: 22235 3" Copper

TAP CLEARED

LOCATION: ²¹ N.S. 87 Cove St. W. of Harbor St.

OWNER: Hathaway Mfg. Co.

MEASURES: 3" Copper 7/31/46
 1-3" Darl. Tap. Gate; 1-4" C.I. gate box 205#
 W from W line Vail 47.7 ft.
 N from S line Cove 19.7 ft.
 E from W line Building 21.0 ft.

✓ Jan. 10, 1989 This service broken by Frank Corp. while installing tel. duct. Repaired with 3" straight sweat cplg. up from old sweat 45°; 1 new 45° sweat cplg. south, 4 ft. - 3" copper to 3" Smith Blair #227 clamp.
 Tie in 4 ft. S x north curb line.
 14 ft. S x N line Cove S t.
 Both 45° are 30" apart with straight coupling in center, all this done to bring copper up from under curb & over big size drain. Service is now over drain & under 2 - 3" tel. ducts and about 30" deep. All work done by Frank Corp. & is on the shaky side since the proper fittings could not be found.

✓ Sept. 26, 1994 Repaired 3" Tapping gate valve. Overturning of valve.
 Top section gate & spindle, gasket, 6-2½" x ½" bolts & nuts
 1 - #10 Gate Box, compl.

~~7/21/46~~ BEDG

5/29/19: Killed service at main Century Paving contractor
 inspector P. Reynolds (11ft of main removed)

[illegible]

22235-2 "

DEC. 10 1986

S/WALK 0+00
3" COVERED

CURB
KIND


DRAIN

TRANSIT CAMP

NEW 2'-3" DIA DUCTS PLUMB

22' C-22

3" TO MAIN

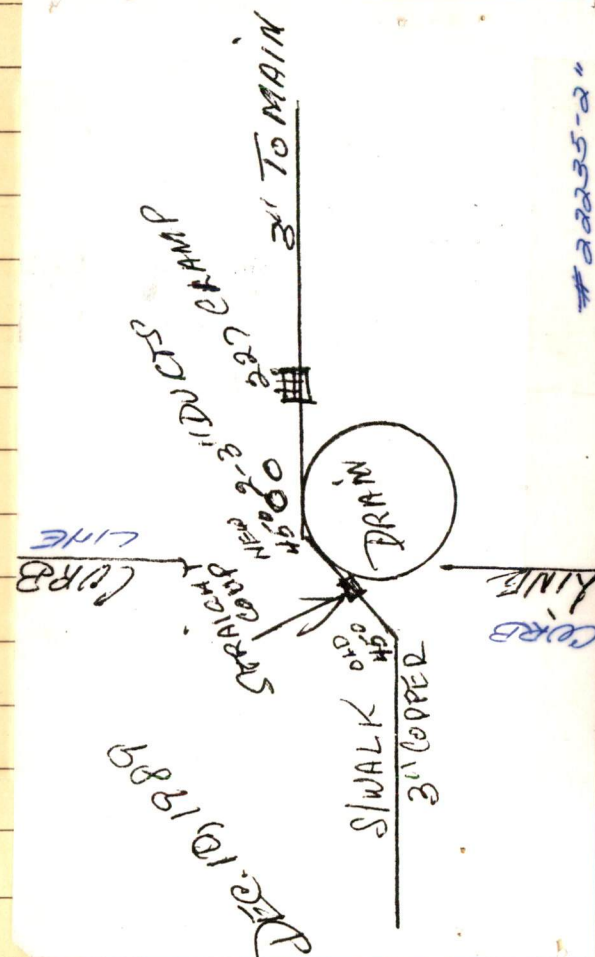

APPLICATION No.: 34042 - FS

LOCATION: ~~73~~ Cove Street

OWNER:

31-313

MEASURES:

8" FIRE SUPPLY P.21 L.53

Storage Facility

E x E line Viall St 17.0'

S x N Line Cove St 38.0'

W x W line building 17.0'

S x S line building 38.0'

Main to property line 39.5'

pipe inside property 28.0'

6-12-2019: New service installed by Century paving
Test Pressure 200 PSI 2hour Static 90 PSI

TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

[illegible]

CHARGE OUTS

[illegible]