

Conway St.

# 28065

October 22, 1969

F.E. McGowan

N.W. Cor. Conway St., & Cape St.

Please install 6" Fire Supply C.L.C.I  
service to supply trucking garage.


Measures of 8" Mechanical Gate Valve:

|                        |       |
|------------------------|-------|
| W x W line Cape Street | 258.0 |
| S x W " Conway Street  | 42.6  |
| W x W " Building       | 71.0  |

8" - outside prop. line - done by South Terminal  
Contractor

6" - inside prop. line - done by Harriet Trans-  
port Corp. - 12' of 8" pipe inside  
see sketch


HARRIET TRANSPORT  
CONWAY ST

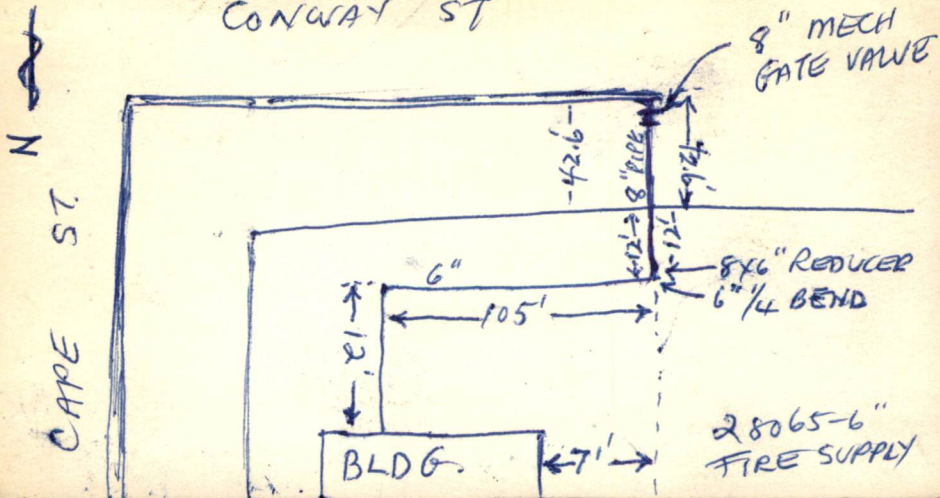


HARRIET TRANSPORT

CONWAY ST

8" GATE



CAPE ST

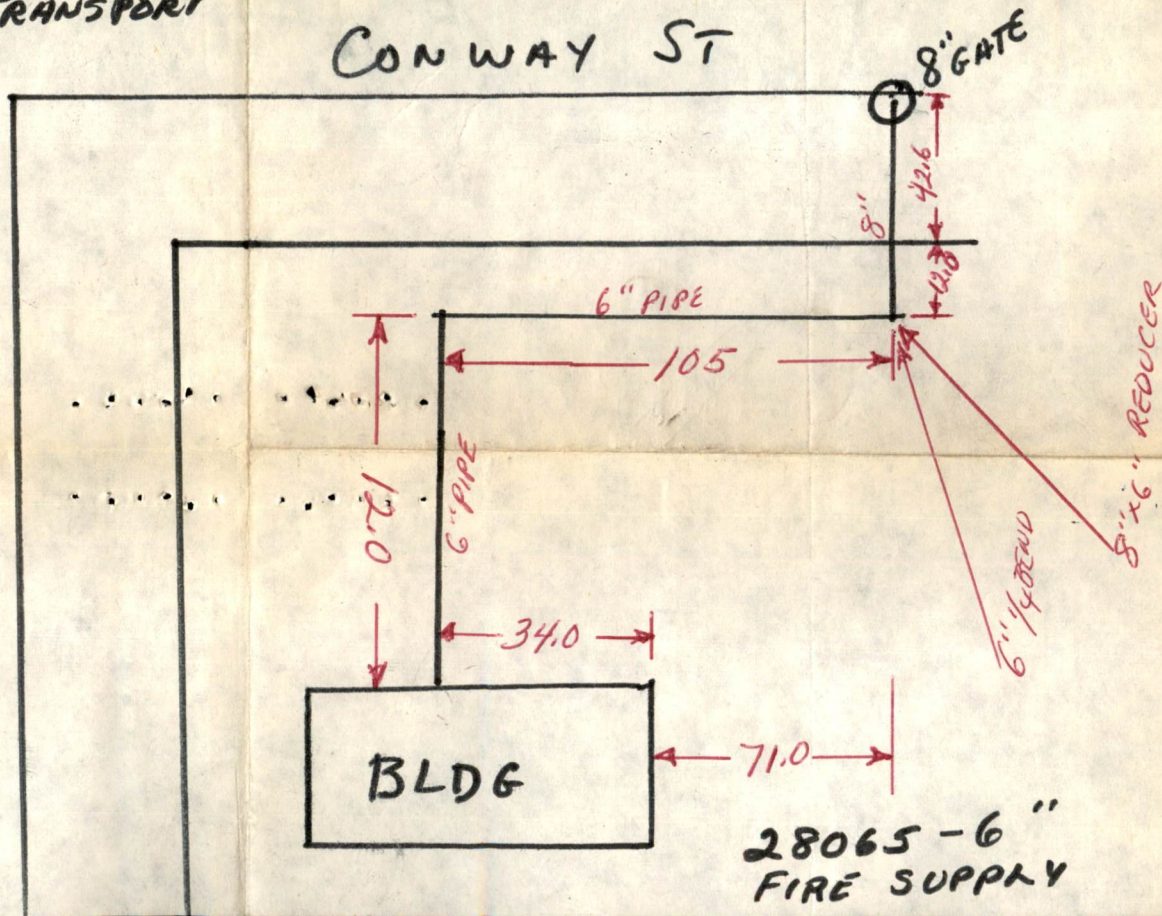

28065-6"  
FIRE SUPPLY

