

143 APPLICATION No.: 28732  
LOCATION: N.S. Clifford St., "x Arlington St.

OWNER: Arnold Briden, Trustee

MEASURES: 1 1/2" Oct. 17, 1972

W from W	Arlington St.	81.0 ft.
S from N	Clifford	7.0 ft.
E from W	Bldg.	20.0 ft.
S from S	Bldg.	15.0 ft.

Main is 32 ft. S x N line.  
Partly laid with d rain

1" Copper Service  
09/07/2022 2022 Water main improvement program  
Contractor: C. Naughton Corp.  
Type CU Diameter 1.5"  
Distance from main to curb 25'  
Distance from curb stop to meter N/A  
Distance curb face to curb stop 1.5'  
Depth of Service 4.50'  
Total length of new pipe installed 25'  
Curb Stop replaced yes size 1"  
Corporation replaced yes 1"  
Ball Valve replaced yes N/A  
Remarks: Type A-1 1/2" Copper to new cur stop.


TAP CLEARED

DATE	BEF.	AFT.	REMARKS
------	------	------	---------

# METER HISTORY

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

## CHARGE OUTS

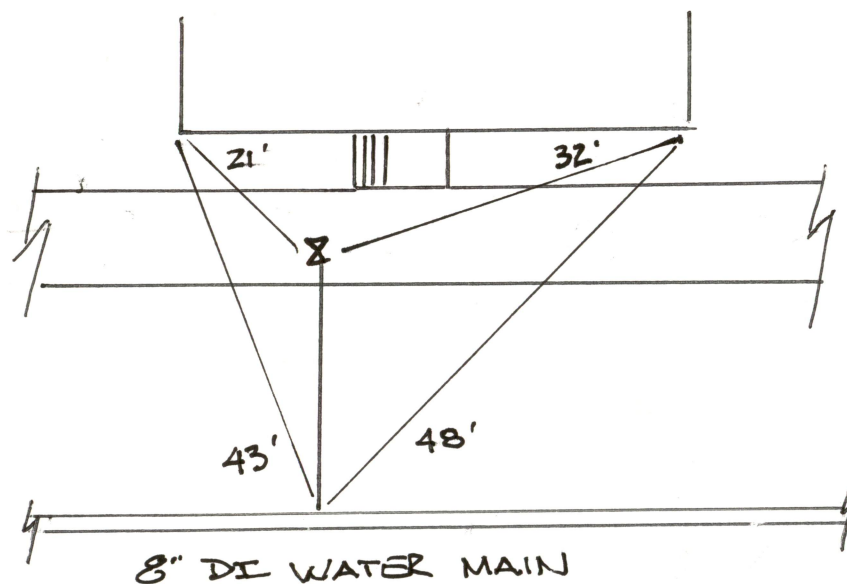

8" DI WATER MAIN

CLIFFORD ST.