

APPLICATION No.: 31448

TAP CLEARED

LOCATION: E.S. 700 Acushnet Ave.

OWNER: Jay Jones Plumbers Supply

MEASURES: 8" Ductile Dec. 15, 1989

N x N line Pearl St . 563.0 f t.
W x E line Acushnet Ave. 8.2 ft.
N x S line Bldg. 5.0 ft.
N x old Seneca St. gate 17.7 ft.
S x 2" gate box 2.0 ft.
Main is 20 ft. W x E line.

FIRE

SUPPLY

DATE

BEF.


AFT.

REMARKS

[illegible]

DEC-15/1989

ALL WORK FRICTION CLAMPED
ALSO RODDED J.R

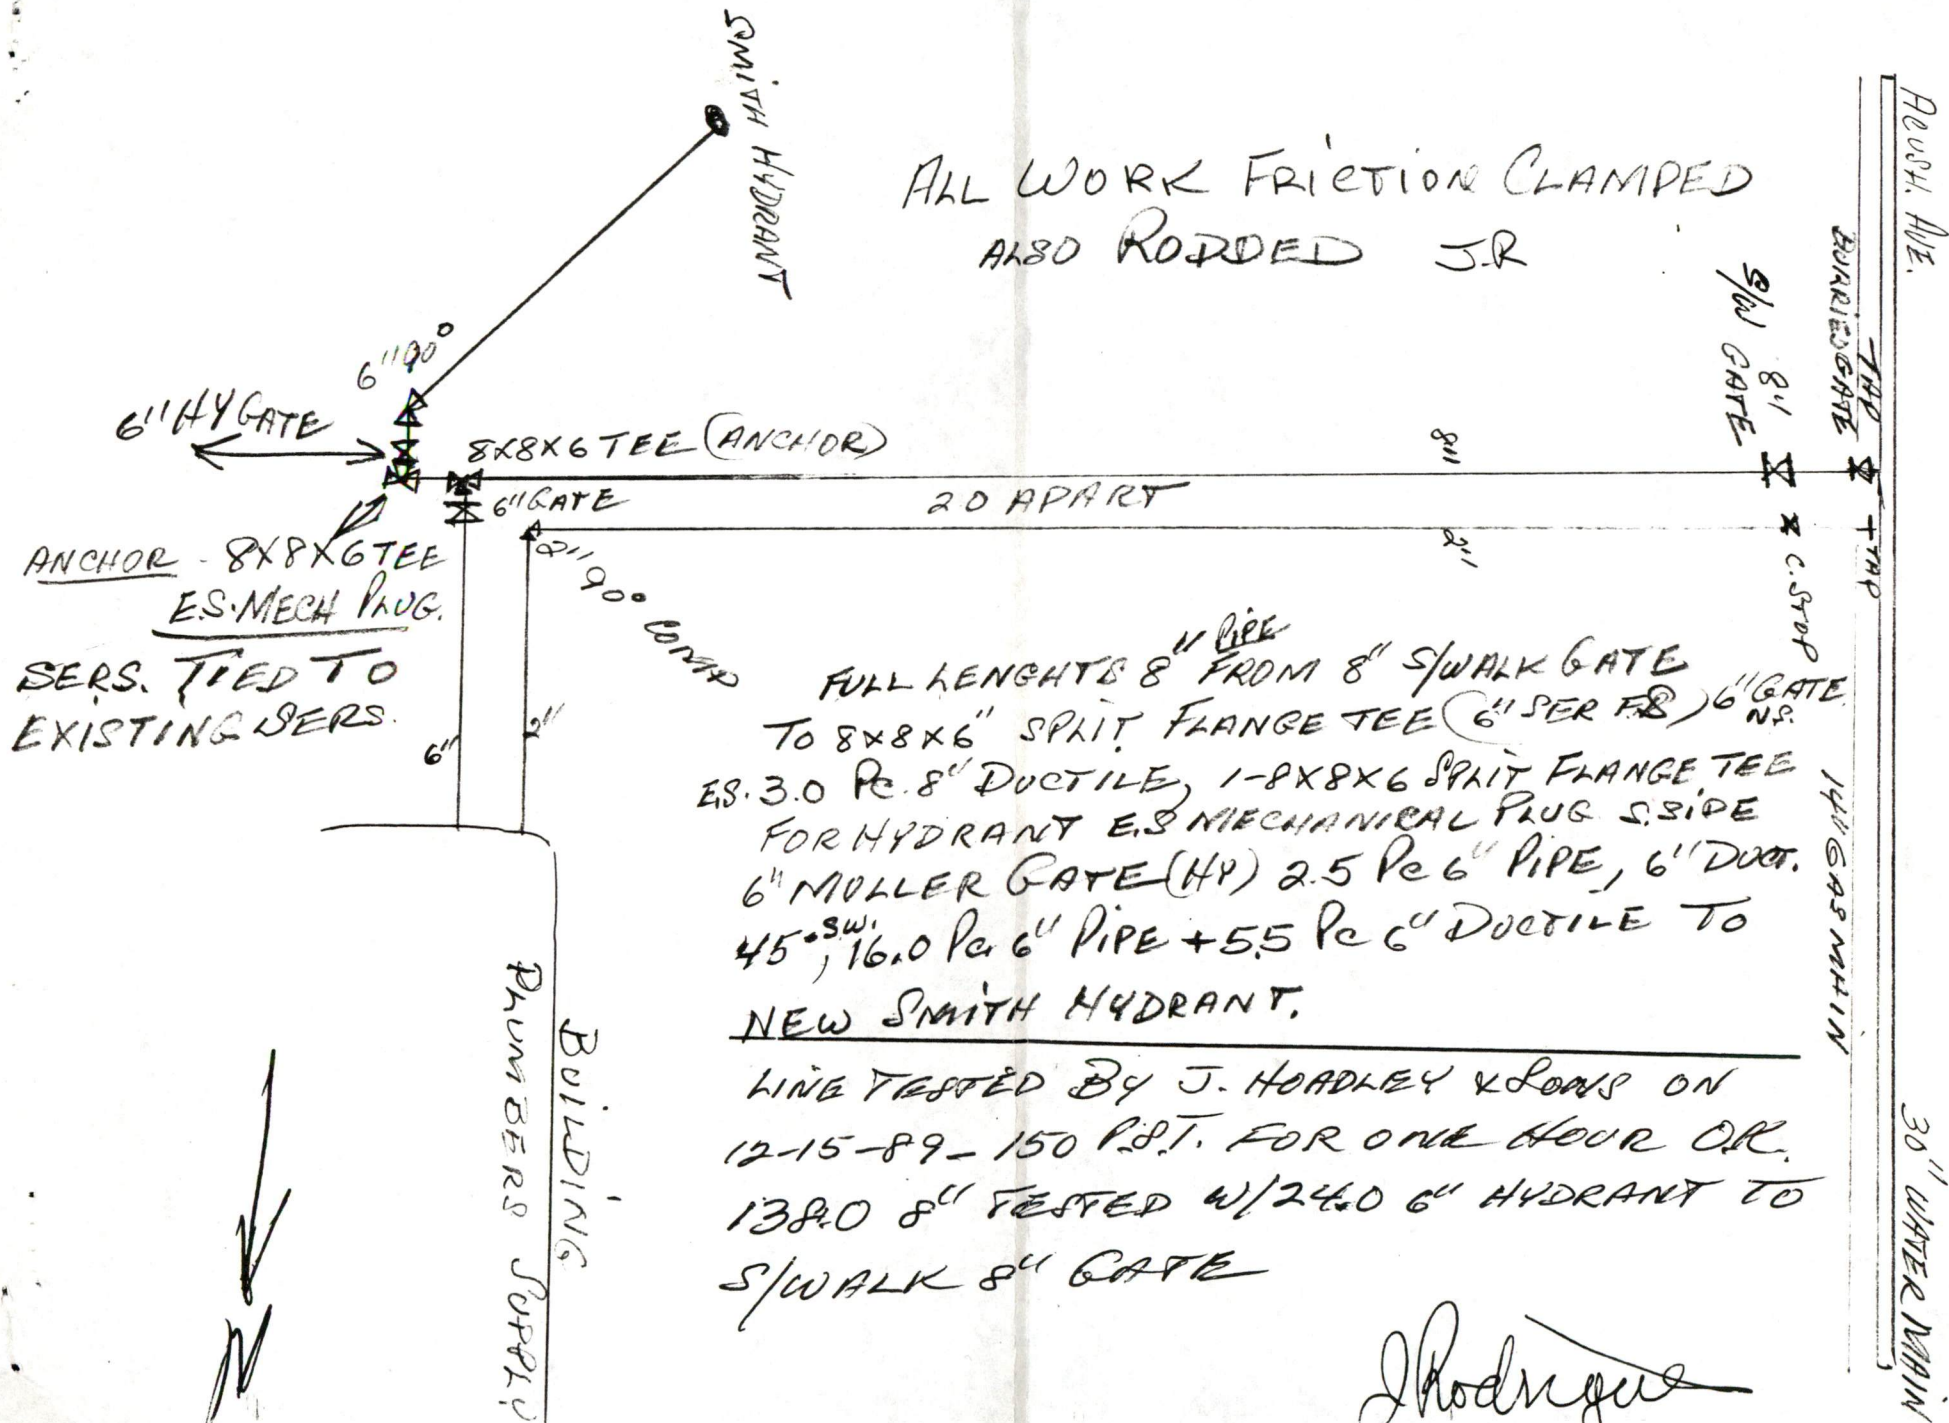

FULL LENGTH 8" PIPE
TO 8x8x6" SPLIT FLANGE TEE (6" PER FB) 6" GATE
ES. 3.0 PC 8" DUCTILE, 1-8x8x6 SPLIT FLANGE TEE
FOR HYDRANT E.S. MECHANICAL PLUG S. SIDE
6" MULLER GATE (HY) 2.5 PC 6" PIPE, 6" DUCT.
45° SW, 16.0 PC 6" PIPE + 5.5 PC 6" DUCTILE TO
NEW SMITH HYDRANT.

LINE TESTED BY J. HODLEY & LOAN ON
12-15-89 - 150 P.S.I. FOR ONE HOUR OK.
138.0 8" TESTED W/ 24.0 6" HYDRANT TO
S/WALK 8" GATE

J. Rodriguez