

LOCATION:

APPLICATION No.:

## TAP CLEARED

31-313

Dec 4, 1878

W from E Line Stone St 4.0'

S from N Line Grape St 6.0'

W from W Line	House	6.0'
---------------	-------	------

1" COPPER SERVICE

6-21-2018:Lead service line replacement program

phase 1, Contractor P. Gioioso & Sons

TYPE CU, Diameter 1inch, Water Pressure 70

Distance from main to curb stop 20.0'

Distance curb stop to meter 22.4'

Distance from curb face to curb stop 2.0'

Depth of service 4.0'

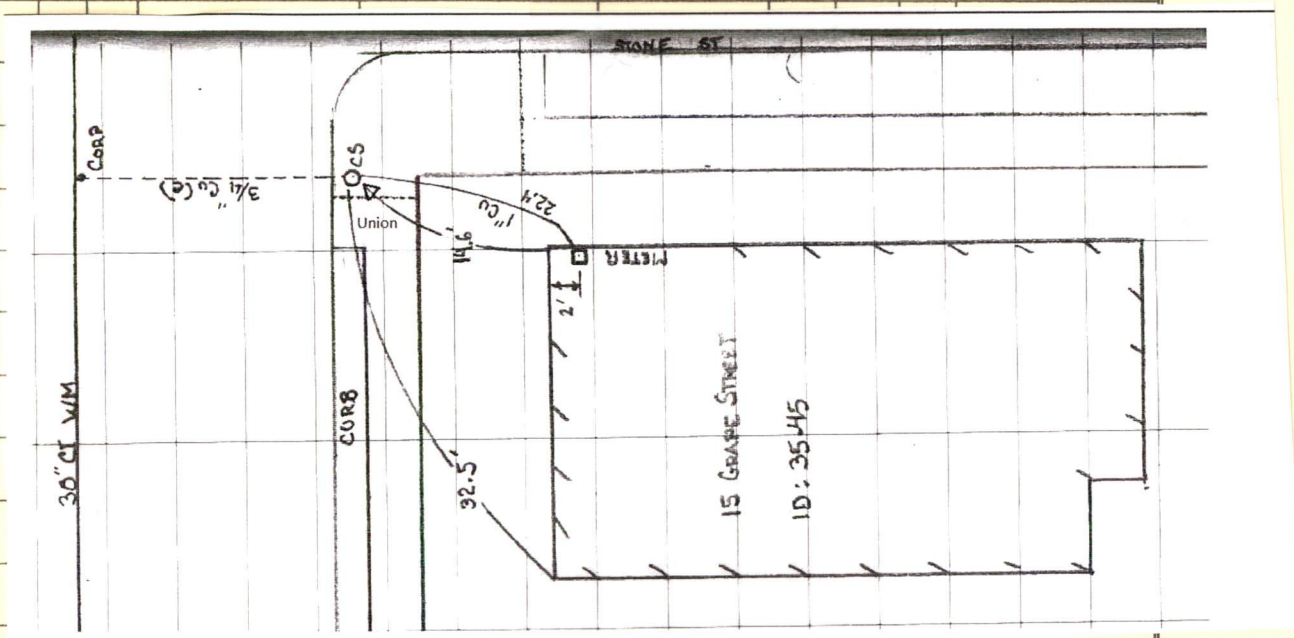
Total length of new pipe installed 22.4'

Curb stop replaced: NO Size 3/4"

Corporation replaced: NO Size 3/4"

Ball Valve furnished: YES Size 1"

9/6/13	Tap reamed
--------	------------

[illegible][illegible]