

APPLICATION No.:

32840

LOCATION:

OWNER:

31-313

MEASURES:

4''

Ductile Iron

12/11/2003

S from S line	Winsper St	14.0
E from W line	Hemlock St	16.7
S from	Hydrant	129.0
N from S line	Building	187.0
S from N line	Building	194.0
E from E line	Building	46.7
Main to property line		18.0
Pipe inside property		29.0

12/11/03 - See sketch attached to card

TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

[illegible]

CHARGE OUTS

[illegible]

DEC 11, 2003


LAWRENCE LYNCH

HEMLOCK ST.

STO + SHOP

8" F.S.

4" D.M.

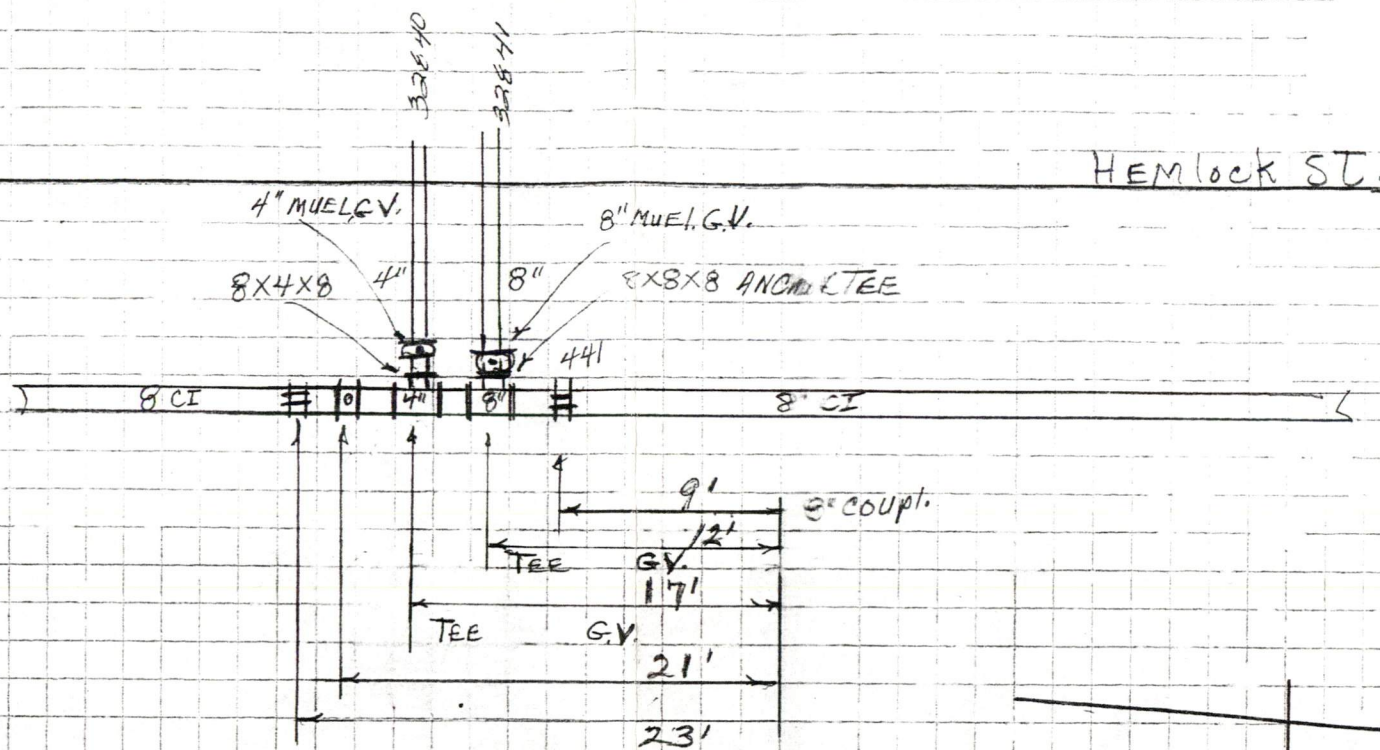

CONTR. INSTALLED 8" FIRE SUPPLY + 4" D.M. ON HEMLOCK ST. STARTING AT A POINT 9' SXL WINSPER ST. INSTALLED IN ORDER - 8" 44, 1.6' PC 8" DI PIPE, 8" X 8" TEE, 1.6' PC 8" PIPE 8" X 4" TEE 1.6' PC 8" PIPE, 8" MUEL G.V., 1.6' PC 8" PIPE, 8" 44 COUPL.

FROM 44 TEE A 1.5' PC 4" PIPE TO 4" G.V. WEST X TEE

8" F.S. G.V.

SXSL WINSPER ST. - 12'

EXWL HEMLOCK ST. -

4" D.M. G.V.

SXSL WINSPER ST. - 14.0'

EXWL HEMLOCK ST. -

DGV

SXSL WINSPER - 17'

EXWL HEMLOCK ST. - 16'

WINSPER ST.