



LOCATION:

OWNER:

31-313

MEASURES:

9/24/2018 1" Copper Service

Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water Pressure 100

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 18

Distance from curb face to curb stop (ft) 2

Depth of service (ft) 4.6

Total length of new pipe installed (ft) 18

Curb stop replaced: no

Corporation replaced: no

Ball valve replaced: yes size 1"

TAP CLEARED

DATE _____

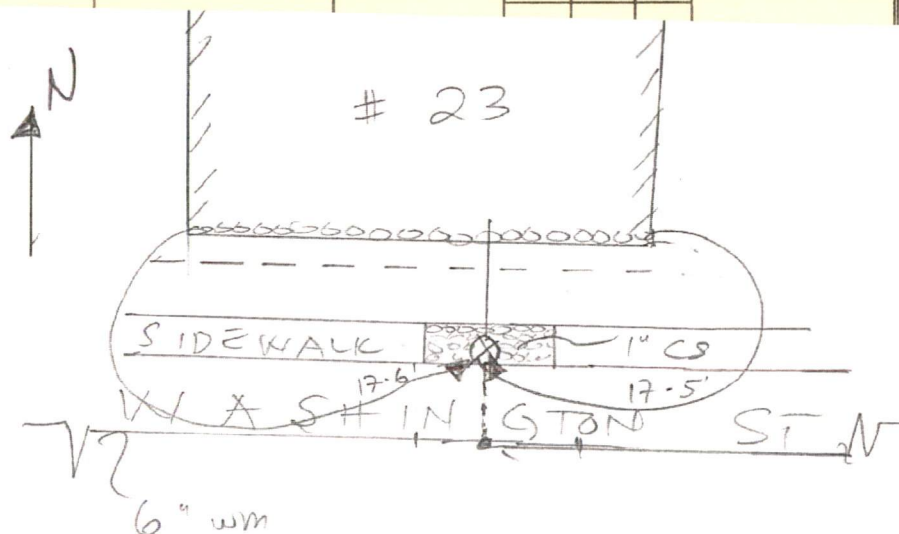
BEF.

AFT.

REMARKS

1 / 26 / 70

6/7/94 Ream

[illegible]

APPLICATION No.: 3697

TAP CLEARED

LOCATION: 23 Washington St.OWNER: JJ Canningham

MEASURES:

5/8"

E from	County	98.1 ft.
S from N	Washington	5.9 ft.
W from E	house	11.3 ft.

Oct. 3, 1975 Renewed from 6" outside curb stop to property line.

6 ft. - 3/4" Copper tubing 3/4" Curb Stop

2 - 5/8" x 3/4" lead to copper adaptor XXS

January 26, 1970 Renewed from the main to a point 2 1/2 ft. from the main.

2 1/2 ft. 3/4" copper tubing 1 3/4" x 3/4" fig. 413

1 wipe joint

6/7/94: REnewed from main to curb stop Stock: 17ft 3/4" copper tubing 1-3/4" curb stop 1-Caldwell stop box 1-3/4x5/8 Fig 413

=====

DATE

BEF.

AFT.

REMARKS

1-26-70

Reamed

6-6-949423-00198clean elot.

6/7/94: tap reamed

[illegible]

CHARGE OUTS

[illegible]