

4747

118 Bonney St

OWNER:

MEASURES

S from Fair St 64.4'

W from E Line Bonney St 7.5'

S from N Line house 2.5'

1" COPPER

10/4/2018: Lead service line replacement program

phase 1: TYPE CU, Diameter 1", Water Pressure 100

Contractor: P. Gioioso & Sons

Distance from main to curb stop 20'

Distance curb stop to meter 18'

Distance from curb face to curb stop 1.0'

Depth of service 4.0'

Total length of new pipe installed 20'

Curb stop replaced: YES Size 1"

Corporation replaced: YES Size 1"

Ball valve furnished:NO Size 3/4"

remarks-	3/4 -1" union installed 1.0 LF outside curb stop
----------	--

TAP CLEARED

DATE _____

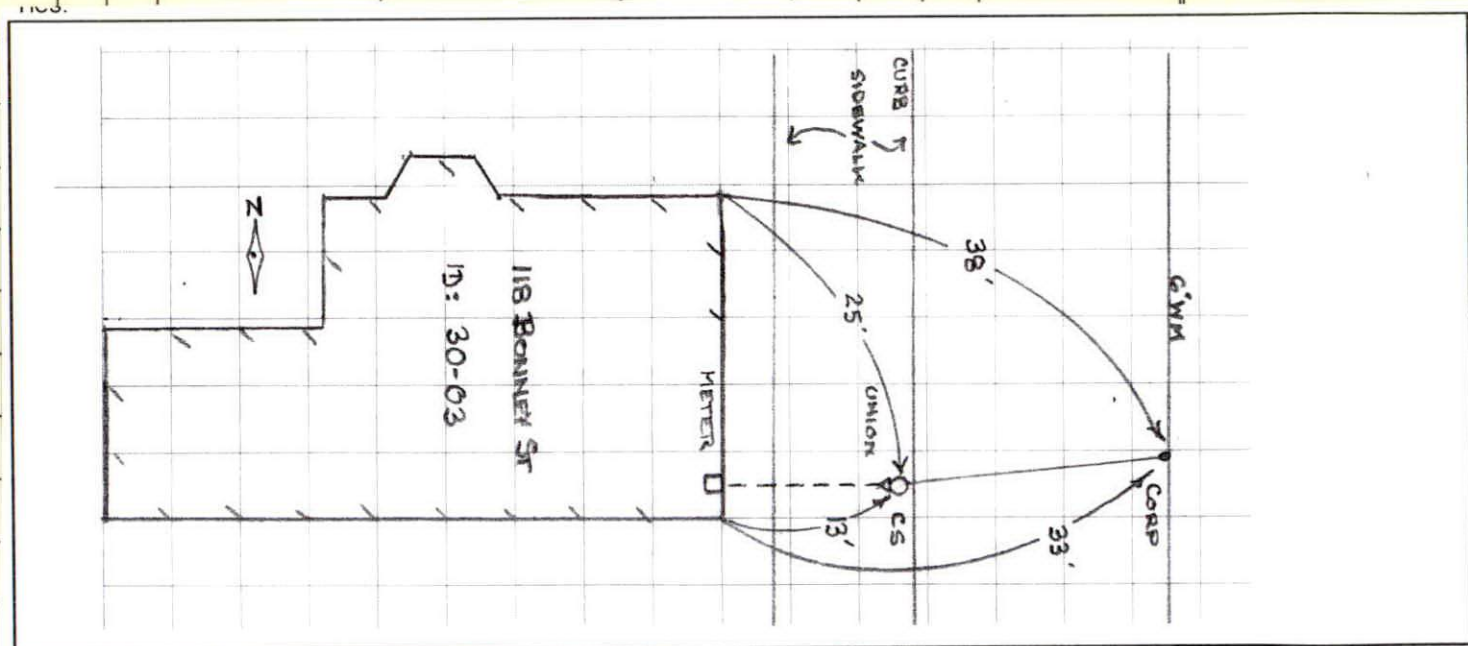
BEF.

AFT.

REMARKS

[illegible]

CHARGE OUTS

[illegible]