

APPLICATION No.: 5968

TAP CLEARED

LOCATION: 433 Cottage St

OWNER:

31-313

MEASURES: Sept. 20, 1888

S from Campbell St 54.0 ft

E from W line Cottage St 6.2 ft

S from N line House 9.1 ft

1" Copper Service

03/19/2020 Lead Service Line Replacement Program

Phase 1 Contractor P Gioioso & Son

Type CU, Diameter (in) 1, Water pressure 55

Distance from main to curb stop (ft) 6

Distance curb stop to meter (ft) 12.5

Distance from curb face to curb stop (ft) 3.0

Depth of service (ft) 4.3

Total length of new pipe installed (ft) 18.5

Curb stop replaced: yes size 1"

Corporation replaced: yes, size 1"

Ball valve replaced: yes, size 1"

DATE

BEF.

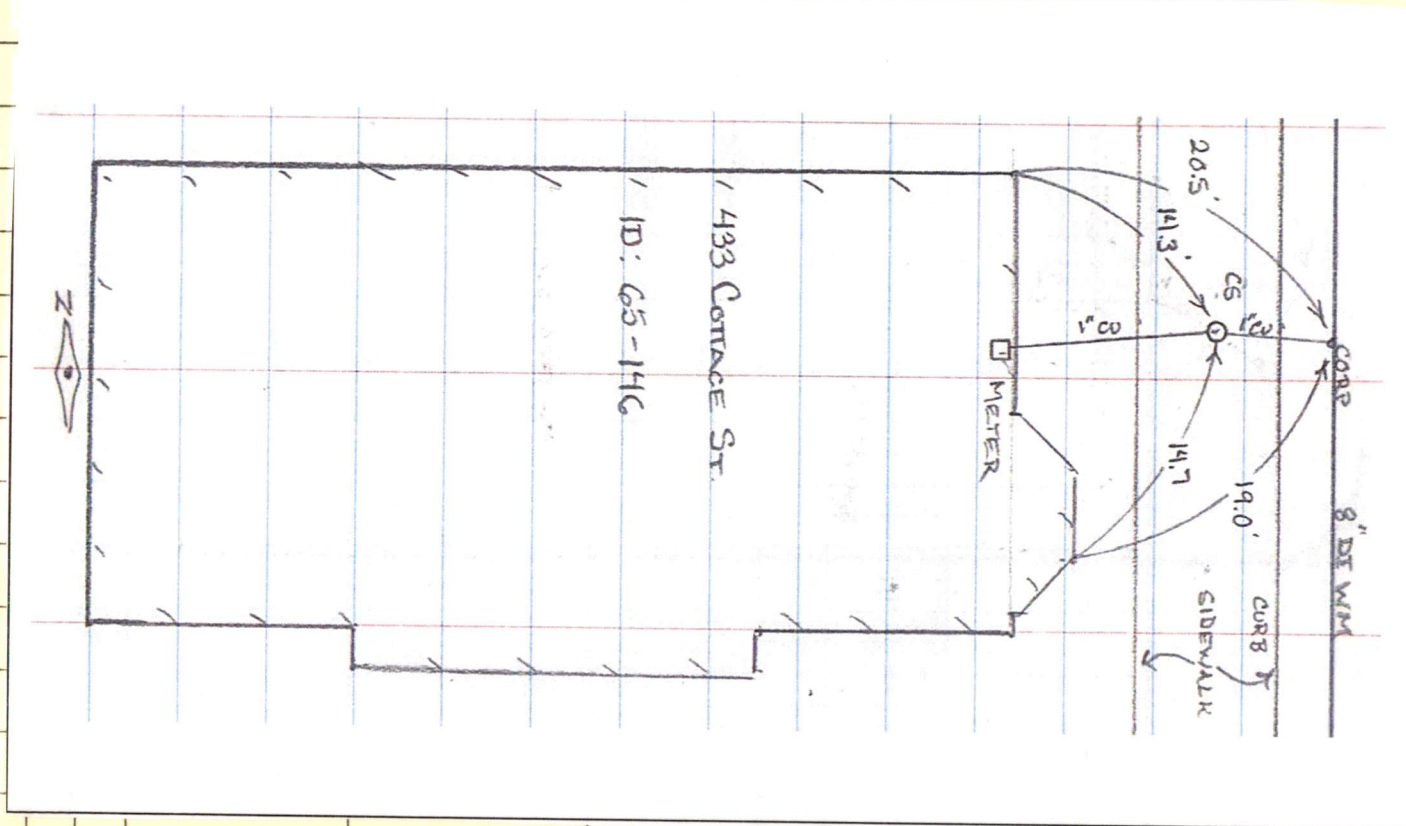
AFT.

REMARKS

6/11/69 Reamed

[illegible]

CHARGE OUTS

[illegible]