
APPLICATION No.: 5973	TAP CLEARED					
OCATION: 207 Rivet St	DATE	BEF.	AFT.	REMARKS		
OWNER:						
EASURES: 1" Copper Service						
12/5/2018 Lead Service Replacement Program						
Phase 1, Contractor P Gioioso & Son						
Type CU, Diameter 1in, Water pressure 95 (corp) Distance from main to curb stop (ft) 25.5						
Distance from curb stop to meter (ft) N/A						
Distance from curb face to curb stop (ft) 1.8						
Depth of service (ft) 4 Total length of new pipe installed (ft) 25.5						
Curb stop replaced: Yes size 1" Corporation replaced: Yes size 1" Ball valve replaced: NO						

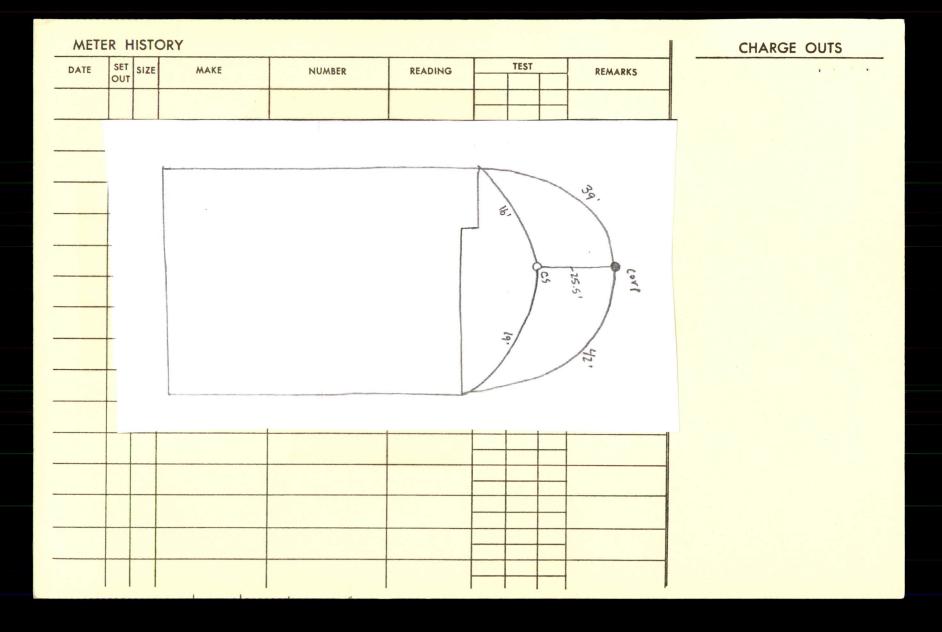

			APPLICATION No.:	5973			TAP	CLEAR	ED 8640 -2160
LOCATION:		207 Rivet	St.			DATE	BEF.	AFT.	REMARKS
OWNER:		Ermidio M	. Pinhe <b>i</b> ro						
MEASURES:									
	5/8"		H lead	Oct.1	,1888		77.00		
	E from		Hall St.	54.5	ft.				
	S from	N line	Rivet St.	9.0	ft.				
	W from	E line	house	13.1	ft.		-		
7/11/80: Renewed from 6" outside curbstop to the prop. 1: 7.5 ft1-3/4" copper; 3/4" curb stop; Caldwell stop box; 2-5/8" x 3/4" lead-cop. adapt. XXS  10/1/86: Renewed from prop line to inside cellar. Stock: 13ft. 3/4" copper tubing 1 - 3/4 x 3/4 cop to cop cplg. comp.									
6/04/2018	cb stop box.cast			- 4					
Daniel Per	ry								
Mariny Wash									
BRADBURY-WARING, INC.									

METER HISTORY									CHARGE OUTS	
DATE	SET	SIZE	MAKE	NUMBER READING TEST REMAR		REMARKS	y			
	100									
6-20-50		10	King	101505						
0=20=30	D	/0	Aing	161565						
					1					
						-				
										The same of the sa
							* * * * * * * * * * * * * * * * * * * *	7		
								199		
									4	
	1				*					
					243 47					
	45H					44.11				
	1				TAKE THE REST					
	-									