

APPLICATION No.: 6250

LOCATION: 24 Mosher St

OWNER:

31-313

MEASURES: Aug 31, 1889
W X County St 222.2 ft
N X S Line Mosher 8.5 ft
W X E Line House 10.2 ft
1" Copper Service
08/01/2019 Lead Service Replacement Program
Phase 1, Contractor P Gioioso & Son
Type CU, Diameter 1in, Water pressure 100
Distance from main to curb stop (ft) 10.2
Distance from curb stop to meter (ft) 14.9
Distance from curb face to curb stop (ft) 2.3
Depth of service (ft) 4.5
Total length of new pipe installed (ft) 25.1
Curb stop replaced: yes size 1"
Corporation replaced: yes size 1"
Ball valve replaced: yes size 1"
Remarks: former corp abandoned where shown

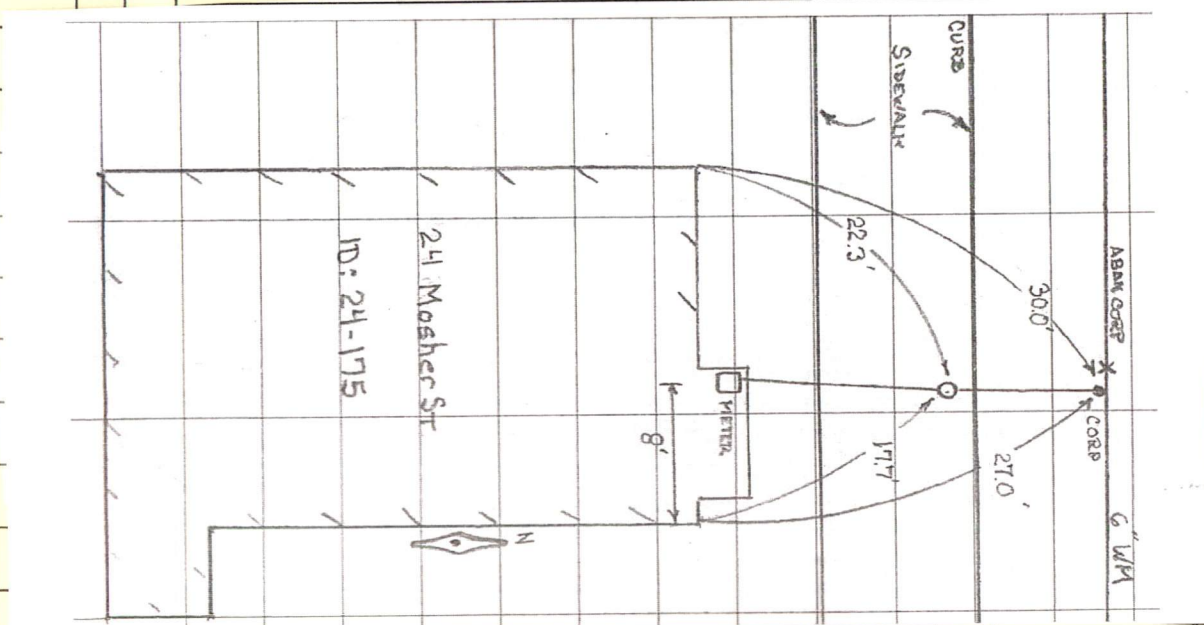
TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

[illegible][illegible]