

APPLICATION No.: 6343

TAP CLEARED

LOCATION: 100 Bonney St.

OWNER: Antone Angelo

MEASURES: 5/8" H lead ~~COPPER~~ Nov. 11, 1889

N from Fair St. 125.0 ft.

W from E line Bonney St. 7.2 ft.

N from S line house 3.3 ft.

June 7, 1965 Renewed service from 6" outside curb  
stop to meter inside cellar

8 1/2 ft. - 3/4" copl to cop. stop; fig 415

1 lb. wiping solder

1 3/4" copper coupling A-1525

250 compressor 1 hr.

1 sidewalk out: 5' x 2' Blacktop

Abraham

Breton

Seopt. 16, 1982 Replaced stop box; 1 Caldwell Stop Box, compl.

09.19.2018 - Lead Service Line REplacement Program

Contractor P. Gioioso and Sons

Type CU, Diameter (in) 1, Water Pressure (PSI) 100

Distance from main to curb stop (ft) 21, Distance curb stop

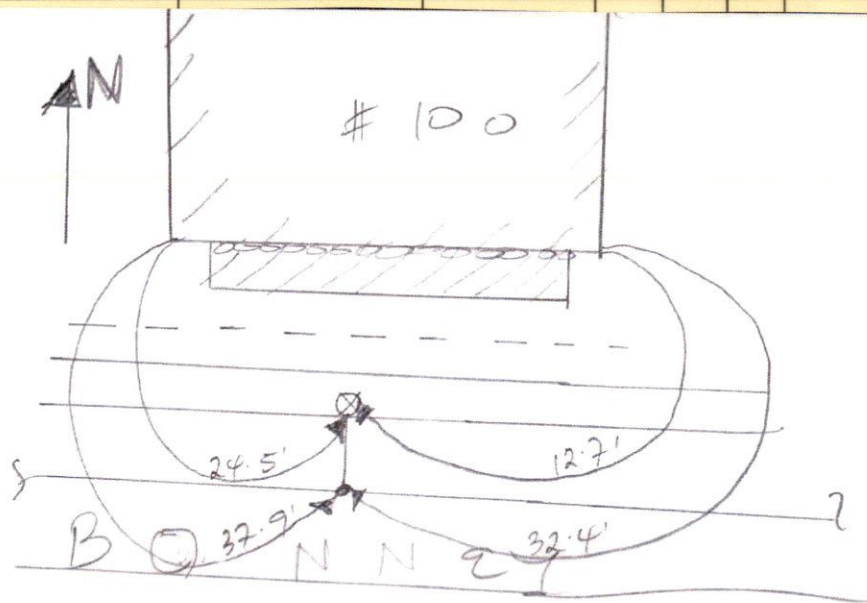
to meter ft 0, Distance from curb face to curb stop (ft) 2.0

Depth of service (ft) 4.0, Total length of new pipe installed

(ft) 21

DATE	SET OUT	SIZE
------	------------	------

## CHARGE OUTS

[illegible]

APPLICATION No.: 6343

TAP CLEARED

LOCATION: 100 Bonney St.

OWNER: \_\_\_\_\_

31-313

MEASURES: Curb stop replaced: Yes, Size 1" Corporation  
Replaced: Yes, Size 1" Ball Valve Furnished: No

DATE

BEF.

AFT.

REMARKS

## METER HISTORY

## CHARGE OUTS

[illegible]