

APPLICATION No.: 6415

TAP CLEARED

LOCATION: 155 Purchase St

DATE

BEF.

AFT.

REMARKS

OWNER:

31-313

MEASURES: 1" Copper Service

05/28/2019 Lead Service Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 20

Distance from curb face to curb stop (ft) 2

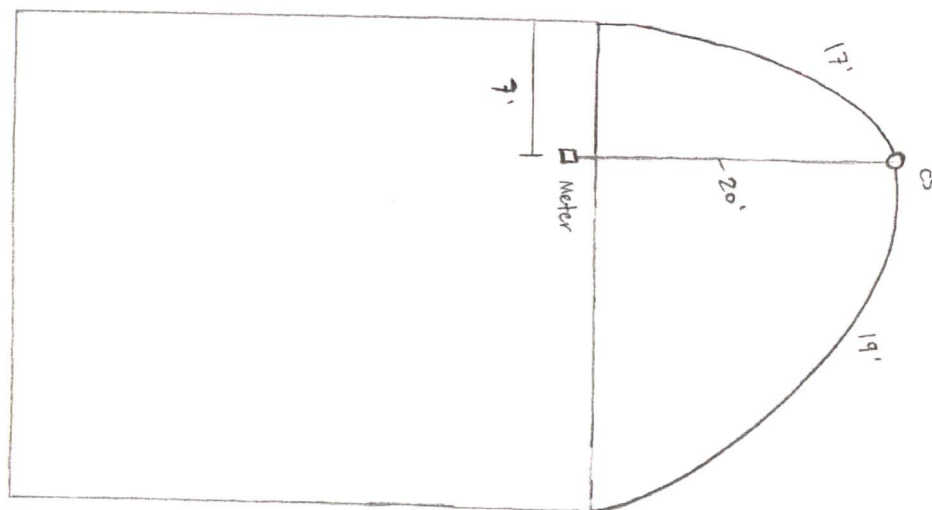
Depth of service (Ft) 4

Total length of new pipe installed (ft) 20

Curb stop replaced: No

Corporation replaced: No

Ball valve replaced: Yes size 1"

[illegible][illegible][illegible]

APPLICATION No.: 6415

TAP CLEARED

LOCATION: 155 Purchase St.

OWNER: Minnie F. Cussell

MEASURES:

 $\frac{1}{2}$ "

H lead

Apr. 7, 1890

N from

Potomska St.

112.1 ft.

E from W line

Purchase St.

6.6 ft.

S from N line

house

9.9 ft.

December 5, 1967 Renewed from $\frac{1}{2}$ ft. outside curb stop to property line
8 ft. $\frac{3}{4}$ " copper tubing used. Total 1 $\frac{3}{4}$ " curb stop. Mueller
2 wiped joints

9/20/78: Renewed from main to 2 ft. front of main.
2 ft.-3/4" copper; 5/8" x 3/4" Fig. 413; 5/8" x 3/4"
lead to cop. adapt. XS

11/17/78: Renewed from main to 1 ft. inside prop. line.
15 ft.-3/4" copper; 3/4" curb stop; 5/8" x 3/4" lead-cop
adapt. XS; 5/8" x 3/4" Figure 413

Owner	did	not	want	to	renew.
can	still	hear	water	running.	

[illegible]

APPLICATION No.: 6415

TAP CLEARED

LOCATION: 155 Purchase St.

DATE

BEF.

AFT.

REMARKS

OWNER: Minnie F. Cussell

31-313

MEASURES:

SEWER SER. NOT PLOTTED

6/24/03 Blocked 6" private sewer line running North on
Purchase St. to 12" City owned sewer main on Rockland St.
Work: Excavated WS Purchase St 120' N of 155 Purchase ST. 12' E of
W gutter line. At 4½' deep, found 2 - 6" clay sewer lines.
Repaired & cleaned both lines. Dye tested #155 to find out which
one was theirs.

[illegible]

CHARGE OUTS

[illegible]