

APPLICATION No.: 6505

LOCATION: 61 Washington St

OWNER:

31-313

MEASURES:

W X County St

231.2 ft

S X N Washington St

7.4 ft

W X E House

8.4 ft

1" Copper Service 9/27/2018

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 80

Distance from curb stop to main (ft) 19.7

Distance from curb stop to meter (ft) 16.6

Distance from curb face to curb stop (Ft) 2.1

Depth of service (ft) 3.9

Total length of new pipe installed (ft) 36.3

Curb stop replaced: Yes size 1"

Corporation replaced: Yes size 1"

Ball valve replaced: Yes size 1"

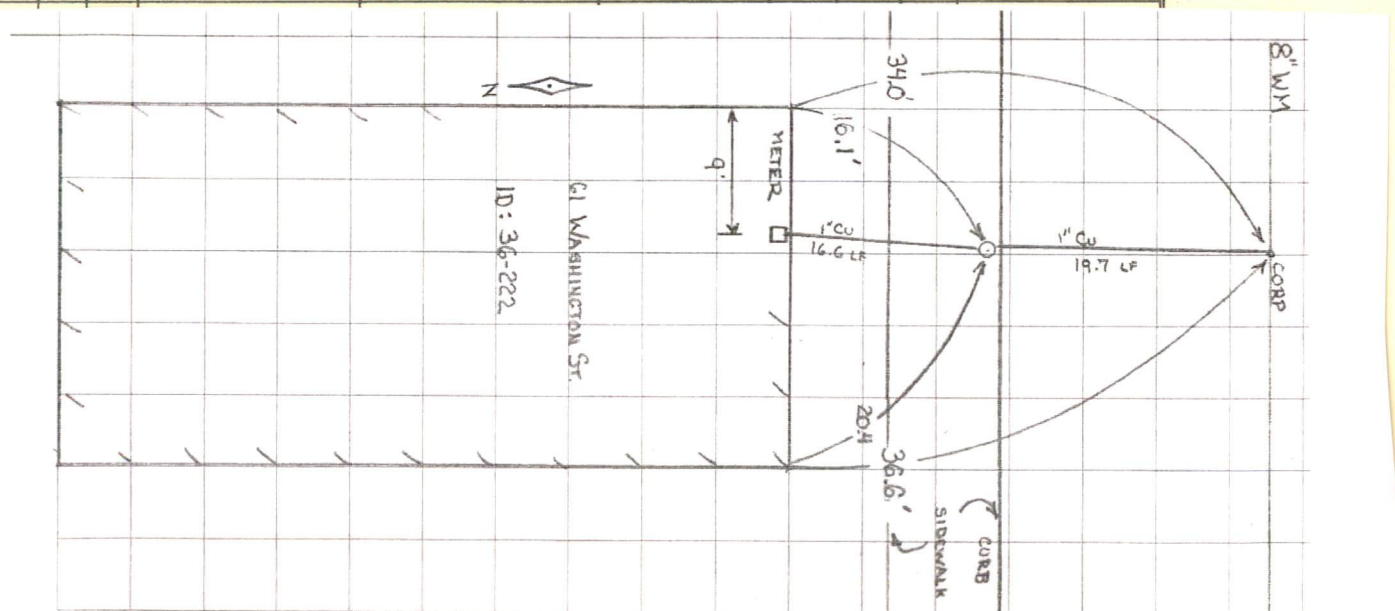
TAP CLEARED


DATE

BEF.

AFT.

REMARKS

[illegible][illegible]

APPLICATION No.: 6505TAP CLEARED LOCATION: 61 WashingtonOWNER: John S SullivanMEASURES: 5/8"

W from	County	231.2 ft.
S from N	Washington	7.4 ft.
W from E	house	8.4 ft.

9/27/78: Renewed 6" outside curb stp to 3 ft. inside  
curb stop. 3.7 ft.-3/4" copper; 2-5/8" x 3/4" lead to cop.  
adapt. Xs; 3/4" curb stop; Caldwell stop box;

DATE

BEF.

AFT.

REMARKS



[illegible]