

APPLICATION No.: 7581

LOCATION: 8 Viall St

OWNER:

31-313

MEASURES:	S X Cove	113.3 ft
	W X E Viall	9.0 ft
	N X S House	11.2 ft

4/29/2019 1" Copper Service
Lead Service Line Replacement Program
Phase 1, Contractor P Gioioso & Son
Type CU, Diameter 1in, Water pressure 100
Distance from main to curb stop (ft) 25
Distance curb stop to property line (ft) 8
Distance from curb face to curb stop (ft) 1
Depth of service (ft) 5
Total length of new pipe installed (ft) 33
Curb stop replaced: Yes size 1"
Corporation replaced: Yes size 1"
Ball valve furnished: No

TAP CLEARED

DATE _____

BEF.

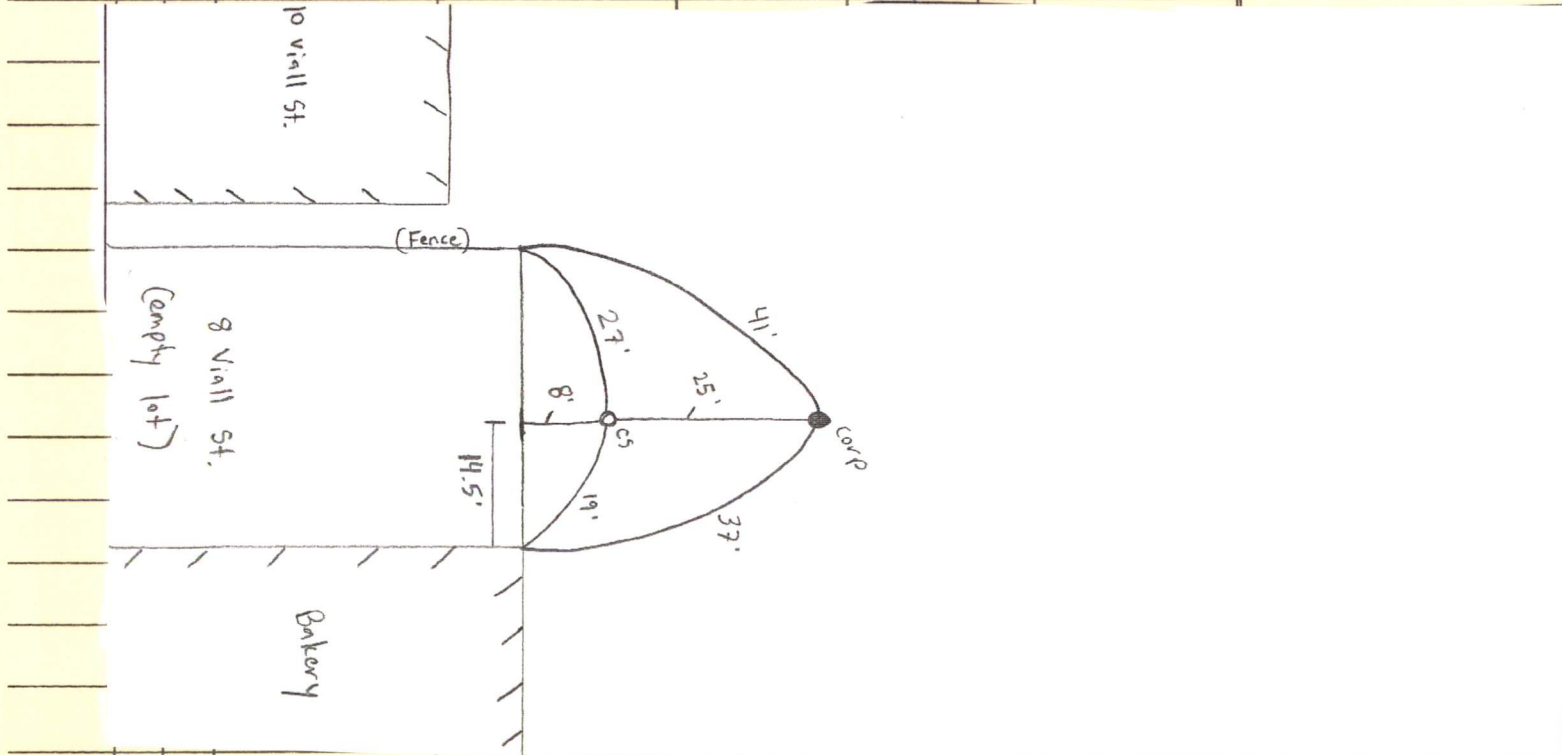
AFT.

REMARKS

7/27/76 Ream

[illegible][illegible]

CHARGE OUTS

[illegible]