

837

10 N. Sixth St

DATE _____

BEF.

AFT.

REMARKS

OWNER:

31-313

MEASURES:

N from Union	74.9 ft
W from E line Sixth	8.4 ft
N from S line Body of home	1.6 ft

11/02/2021 Union St Phase 2

Contractor: C. Naughton Corp

Type CU Diameter 1"

Distance from main to curb stop 29.4 ft

Distance from curb stop to meter 7.5 ft

Distance from curb face to curb stop 2.7 ft

Depth of service 4.0 ft

Total length of new pipe installed 31 ft

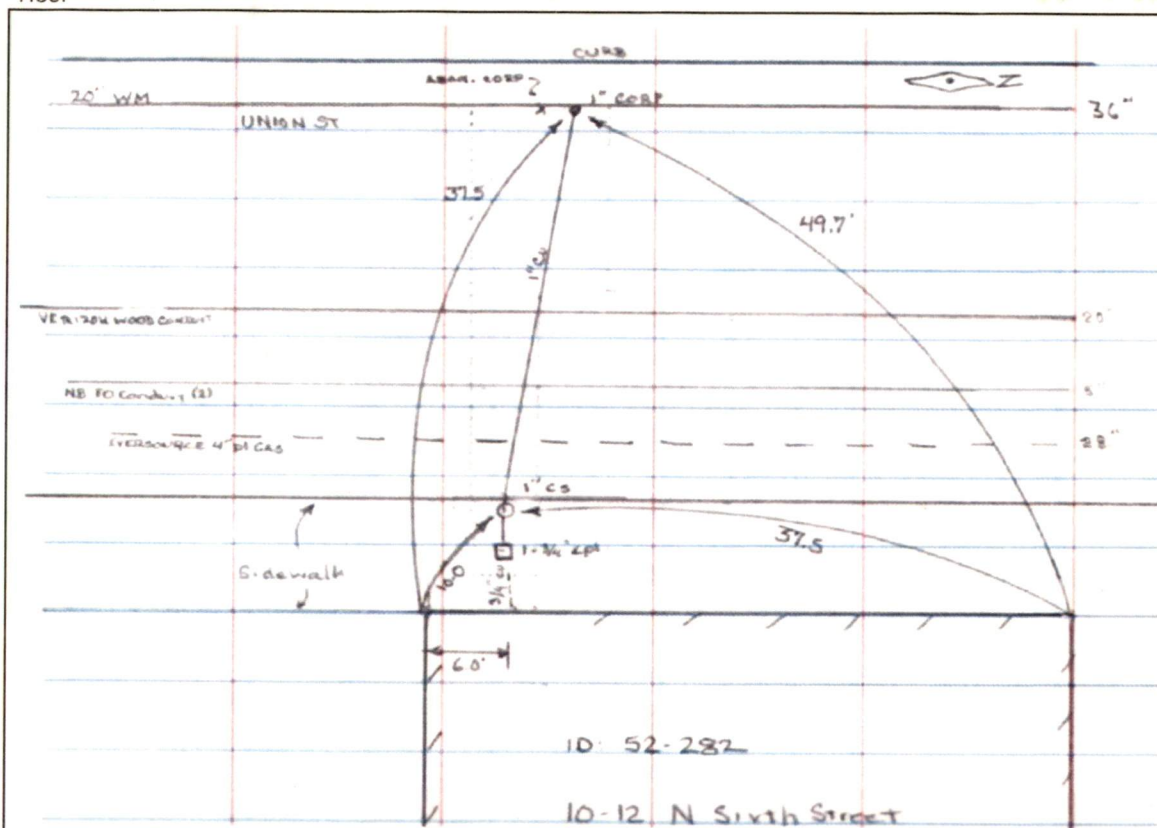
Curb stop replaced - Yes Size – 1"

Corporation replaced - Yes Size – 1"

Ball Valve Replaced – No Size – 3/4"

Remarks 1" union installed where shown

Abandoned corp where shown

[illegible]

Remarks: