

APPLICATION No.: 8410

LOCATION: 143 Division St

TAP CLEARED

OWNER: _____

31-313

MEASURES: November 16, 1895

W X County St 453.0 ft

S X N line Division St 7.0 ft

E X W line House 5.8 ft

1" Copper Service

08/16/2019 - Lead service line replacement program

Phase 1, Contractor P. Gioioso & Son

Type CU, Diameter inch 1, Water pressure 90

Distance from main to curb stop (ft) 20

Distance from curb stop to main (ft) 18.2

Distance from curb face to curb stop (ft) 1.9

Depth of service (ft) 3.8

Total length of new pipe installed (ft) 18.2

Curb stop replaced: no size 3/4"

Corporation replaced: no size 3/4"

Ball Valve furnished: yes size 1"

Remarks: 1-3/4" union installed where shown

DATE

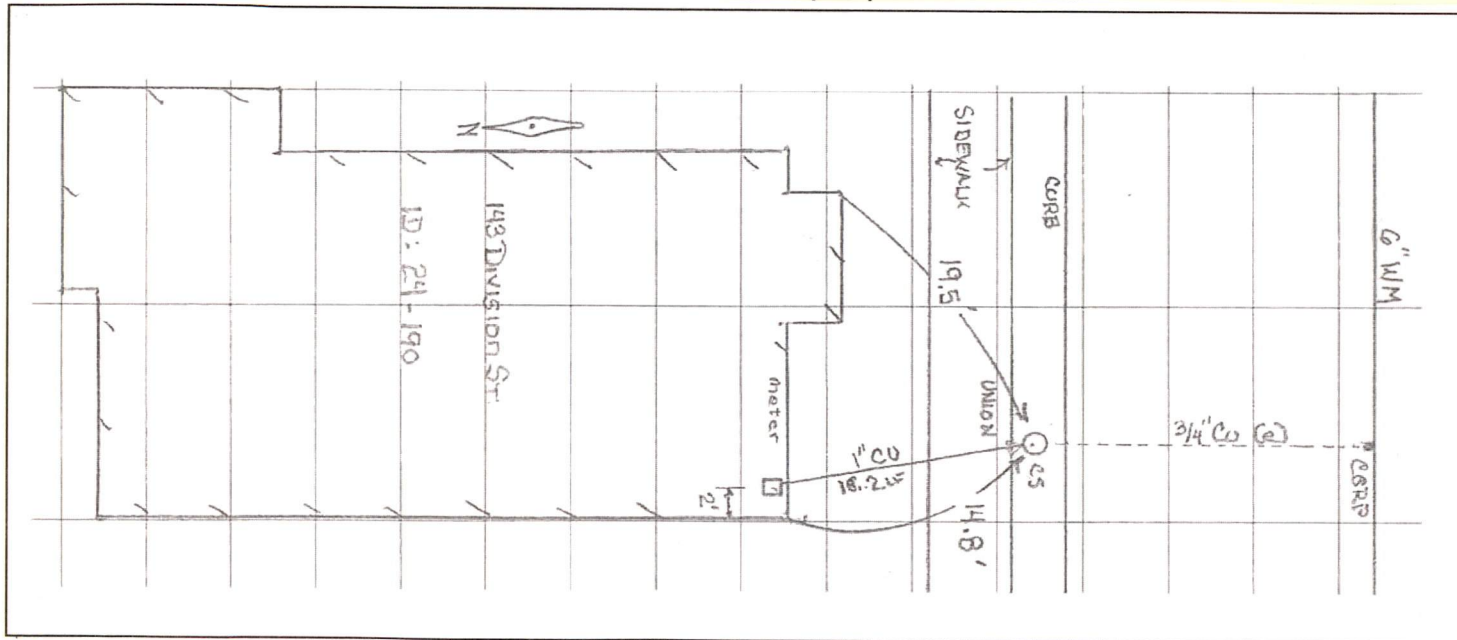
BEF.

AFT.

REMARKS

08/01/1982

01/15/1987

[illegible]

Dependence: