



TAP CLEARED

DATE	BEF.	AFT.	REMARKS
------	------	------	---------

10/25/60	Reame
----------	-------

9/13/85 Reamed

E from W line Cottage St 7.6ft

1" Copper Service

03/25/2020 Lead Service Line Replacement Program

Phase 1 - Contractor P Gioioso & Son

Type CU, Diameter (in) 1, Water Pressure 55

Distance from main to curb stop (ft) 6

Distance from curb stop to meter (ft) 12

Distance from curb face to curb stop (ft) 1.6

Depth of service (ft) 4.0

Total length of new pipe installed (ft) 18

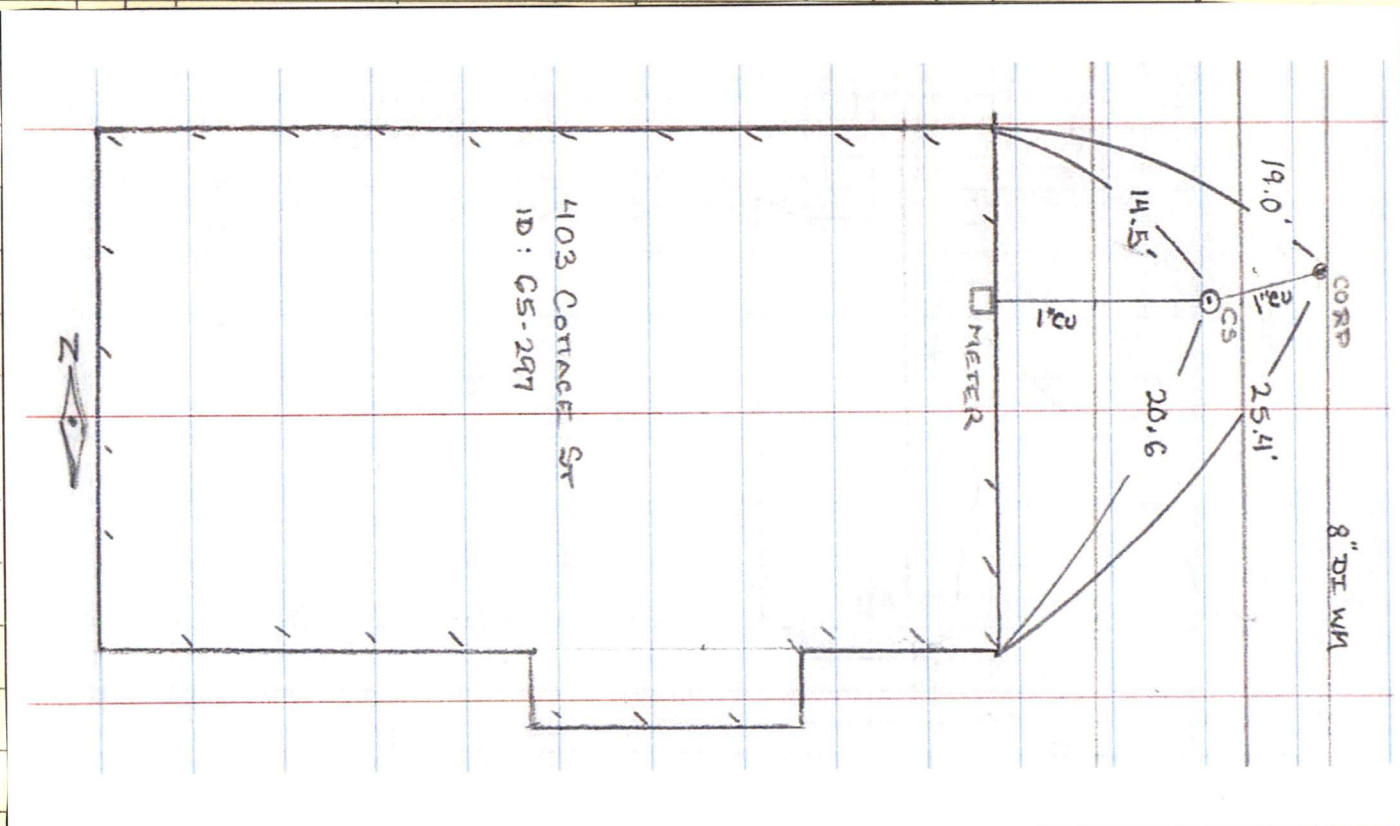
Curb stop replaced: yes, size 1"

Corporation replaced: yes, size 1"

Ball valve replaced: yes, size 1"

[illegible][illegible]

CHARGE OUTS

[illegible]