

LOCATION: 26 Jouvette St

APPLICATION No.: 8696

TAP CLEARED

OWNER:

31-313

MEASURES:

Aug 22, 1896

W X County St 245.1 ft

N X S Line Jouvette St 8.8 ft

E X W Line House 9.3 ft

1" Copper Service

09/18/2019 Lead Service Replacement Program

Phase 1, Contractor P Gioiso & Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) 10.5

Distance from curb stop to meter (ft) 17

Distance from curb face to curb stop (ft) 1.9

Depth of service (ft) 3.8

Total length of new pipe installed (ft) 10.5

Curb stop replaced: yes size 1"

Corporation replaced: yes size 1"

Ball vavle replaced: no size 3/4"

Remarks; 1-3/4" union installed where shown
former corp abandoned where shown

DATE

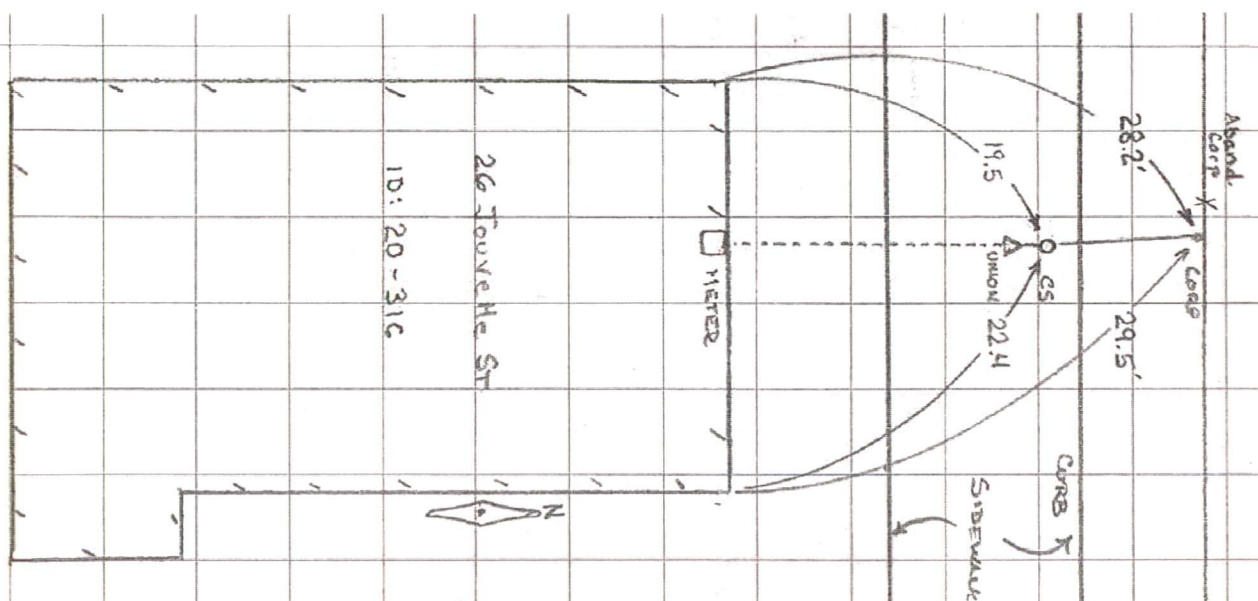
BEF.

AFT.

REMARKS

[illegible][illegible]

CHARGE OUTS

[illegible]