

APPLICATION No.: 8961

LOCATION: 116 Division St

TAP CLEARED

OWNER:

31-313

March 13, 1897

MEASURES:

WX County St 148.2 ft

NX S line Division St 7.2 ft

WX W line # 114 3.8 ft

1" Copper Service

08/13/2019 Lead Service Line Replacement Program
Phase 1, Contractor P. Gioioso & Son

Type CU, Diameter 1in, Water pressure 90

Distance from main to curb stop (ft) 7

Distance from curb stop to meter (ft) 75.7

Distance from curb face to curb stop (ft) 3.5

Depth of service (ft) 3.5

Total length of new pipe installed (ft) 75.7

Curb stop replaced: no size 3/4"

corporation replaced: no size 3/4"

Ball valve furnished: yes size 1"

Remarks: 1-3/4" union installed where shown

DATE

BEF.

AFT.

REMARKS

2/5/85

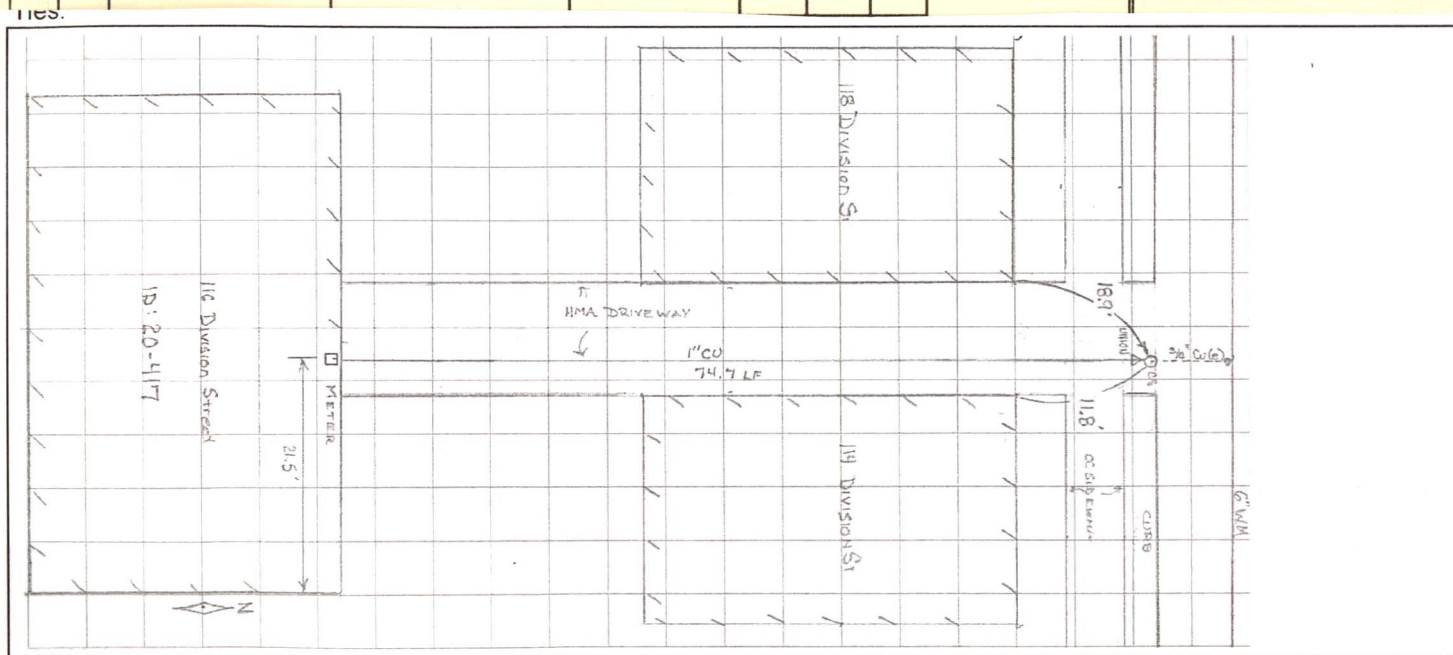
Reamed

7/16/96

Reamed

[illegible]

CHARGE OUTS

[illegible]