

APPLICATION No.: 9518

TAP CLEARED

LOCATION: 55 Bonney St

OWNER: ✓

'31-313

MEASURES: Nov 23, 1898

W from Bonney St 51.9'

S from N line Grinnell St 6.8'

E from W line house 2.5'

1" COPPER SERVICE

6/1/2018: Lead service line replacement program  
phase 1: TYPE CU, Diamter 1", Water Pressure 70

Contractor: P. Gioioso &amp; Sons

Distance from main to curb stop 19'

Distance curb stop to meter 16'

Distance from curb face to curb stop 1.5'

Depth of service 3.5'

Total length of new pipe installed 16'

Curb stop replaced: NO Size 3/4"

Corporation replaced: NO Size 3/4"

Ball Valve furnished: YES Size 1"

Remarks- 1-3/4" union installed where shown

DATE

BEF.


AFT.

REMARKS

[illegible]

### CHARGE OUTS

Ties:

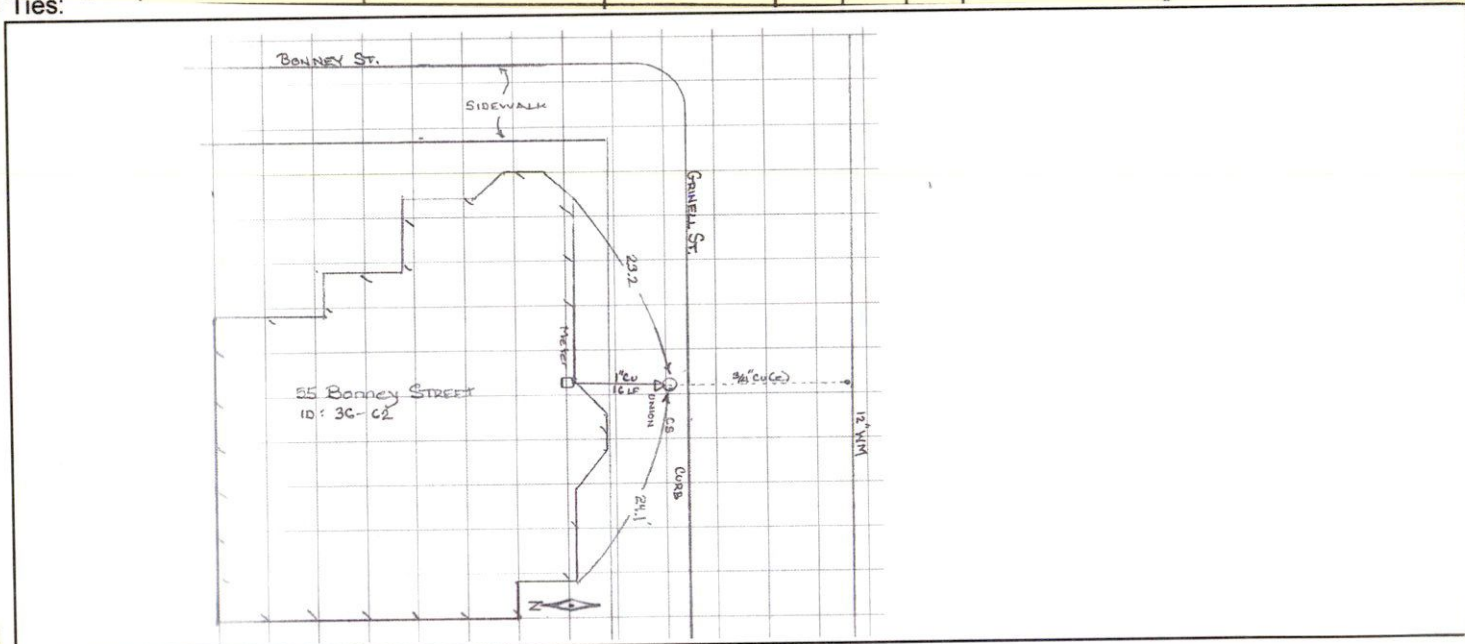

Remarks:

[illegible]