

APPLICATION No.: 9664

LOCATION: 117 South St

TAP CLEARED

OWNER:

31-313

MEASURES:

1" Copper Service

8/28/2018 Lead Service Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (Ft) 21

Distance from curb face to curb stop (Ft) 2

Depth of service (ft) 4.5

Total length of new pipe installed (Ft) 21

Curb stop replaced: no, Corporation replaced: no

Ball valve furnished: yes size 1"


DATE

BEF.

AFT.

REMARKS

[illegible]

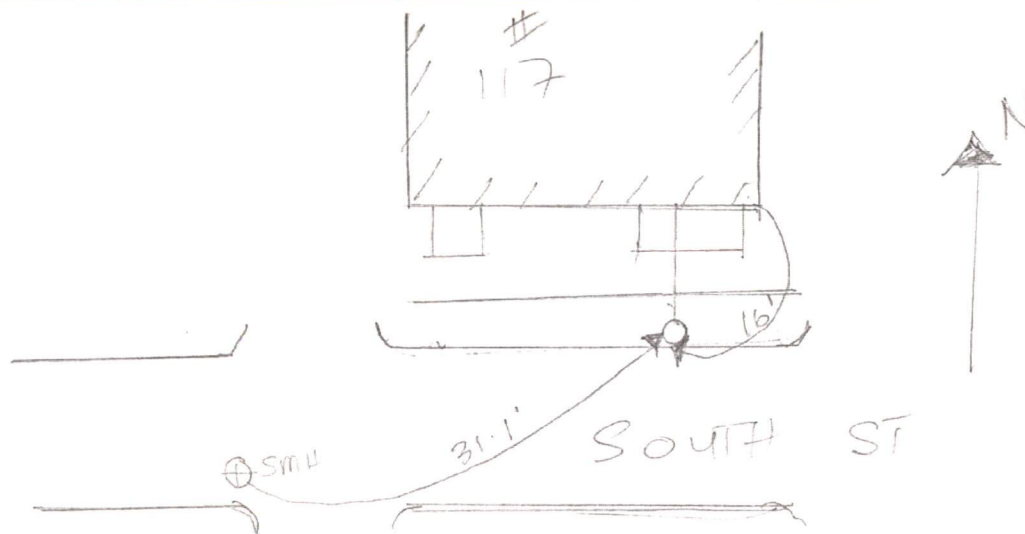

APPLICATION No.: 99664

TAP CLEARED 8406 03 70 ✓

LOCATION: 117 South St.

OWNER: Fannie T. Kaner

MEASURES:

5/8"	H lead	Nov. 1, 1899
E from	Crapo St.	135.0 ft.
S from N line	South St.	8.5 ft.
W from E line	house	7.6 ft.

Feb. 7, 1984 - Renewed from 1/2 ft. outside curb stop to property line.

7 ft. 4 in. - 3/4" copper tubing

1 - 3/4" curb stop 1 stop box

2 - 5/8" x 3/4" lead to copper adaptors XXS

6-16-99 Renewed from main to curb stop, Stock:

27 ft. - 3/4" Copper tubing, 1 - 3/4" Curb Stop

1 - Caldwell Stop Box, 1 - 5/8" x 3/4" Fig. 413.

DATE

BEF.

AFT.

REMARKS

6-16-99 Tap reamed

[illegible]

CHARGE OUTS

[illegible]