

APPLICATION No.: 9932

LOCATION: 107 South St

TAP CLEARED

OWNER:

31-313

MEASURES: 1" Copper Service

8/27/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) 26

Distance from curb stop to meter (ft) N/A

Distance from curb face to curb stop (ft) 2

Depth of service (ft) 4.5

Total length of new pipe installed (ft) 26

Curb stop replaced: Yes size 1"

Corporation replaced: Yes size 1"

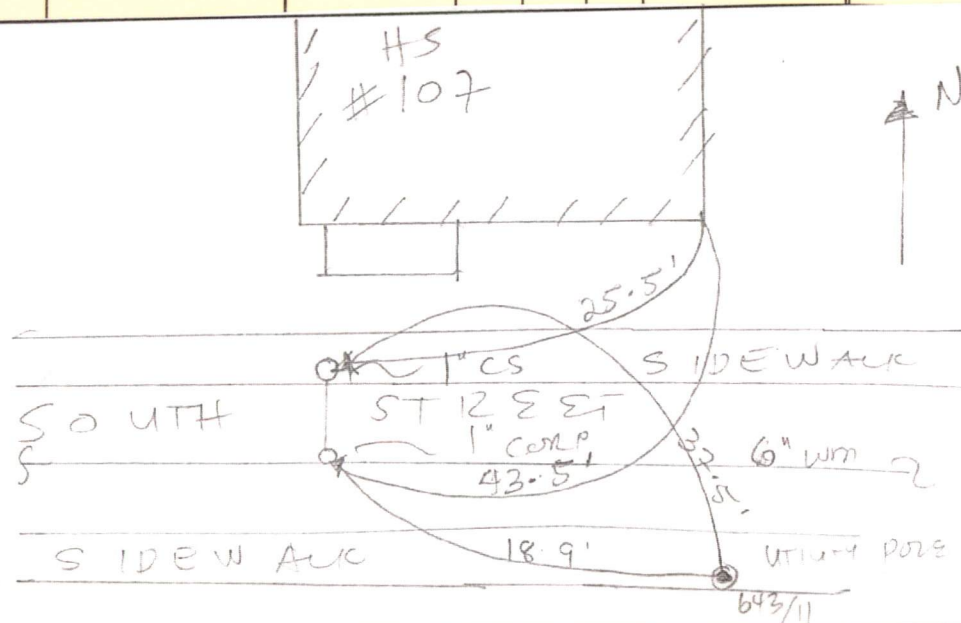
Ball valve replaced: No

DATE

BEF.

AFT.

REMARKS

[illegible]

APPLICATION No.: 9932

TAP CLEARED 8721-271 ✓

LOCATION: 107 South St.

OWNER: Antonio S. Perreira, Et Ux

MEASURES:

5/8" H lead July 19, 1901

E from N line Crapo St. 334.7 ft.

S from N line South St. 9.1 ft.

E from W line house St. 6.0 ft.

Dec. 5, 1974 Renewed from the main to 2 ft. north of the main.

2 ft. - 3/4" Copper tubing 5/8" x 3/4" lead to cop.
3/4" x 3/4" Fig. 413 adaptor

Feb. 28, 1977 Renewed from the 6" outside curbstop to the property line.

8 ft. - 3/4" Copper tubing 3/4" Curb Stop
Caldwell Stop Box 2 - 5/8" lead to copper adaptor5/20/87: Renewed from curb stop to ins. cellar.
(10 ft. ins. prop line) Stock: 20ft. 3/4" copper tubing
=====

DATE

BEF.

AFT.

REMARKS

12/5/74

Reamed

[illegible]