

APPLICATION No.: 9952

LOCATION: 113 South St

V

TAP CLEARED

OWNER:

31-313

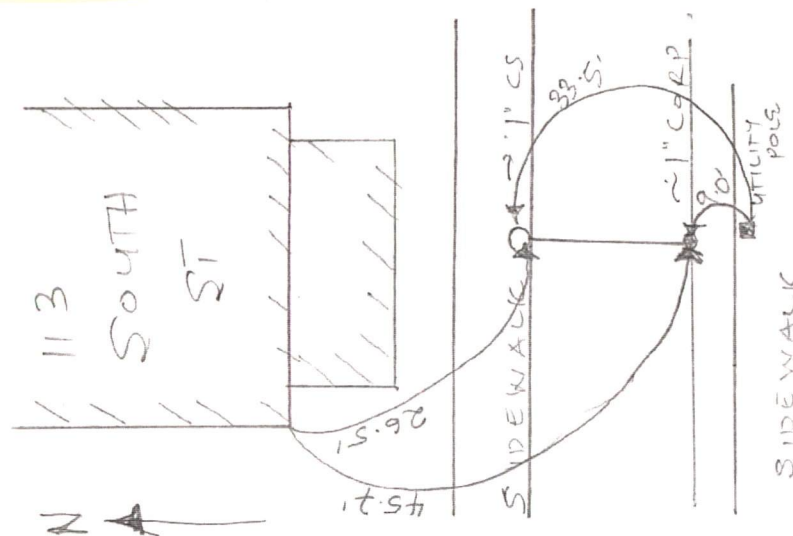
MEASURES: 1" Copper Service
08/24/2018 Lead Service Replacement Program
Phase 1, Contractor P Gioioso & Son
Type CU, Diameter 1in, Water pressure 100
Distance from curb stop to main (ft) 26
Distance from curb stop to meter (ft) N/A
Distance from curb face to curb stop (ft) 1.5
Depth of service (ft) 4.7
Total length of new pipe installed (Ft) 26
Curb stop replaced: Yes size 1"
Corporation replaced: Yes size 1"
Ball valve replaced: NO

DATE

BEF.

AFT.

REMARKS

[illegible]

APPLICATION No.: 9952

TAP CLEARED 8636-1101

LOCATION: 113 South St.

OWNER: Leonard Guilbeault, Et Ux

MEASURES:

5/8" H lead July 19, 1901

E from Crapo St. 217.5 ft.

S from N line South St. 9.0 ft.

W from E line house 4.0 ft.

July 19, 1967 Renewed from $\frac{1}{2}$ ft. outside curb stop to inside of the cellar.

22 $\frac{1}{2}$ ft. of 3/4" copper tubing used. Total.

10 $\frac{1}{2}$ ft. of 3/4" copper tubing from $\frac{1}{8}$ ft. outside curb stop to inside of the cellar.

12 ft. of 3/4" copper tubing from property line to inside of cellar.

1 3/4" curb stop. Mueller 1 wipe joint

1 Caldwell stop box, complete long bottom

9/10/86: Renewed from main to a point 1.0 ft. Stock: 1.0 ft.

3/4" copper tubing 1 - 3/4 x 5/8 lead to cop adapt. xxs

1 - $3/4 \times 5/8$ Fig. 413

[illegible]

CHARGE OUTS

[illegible]